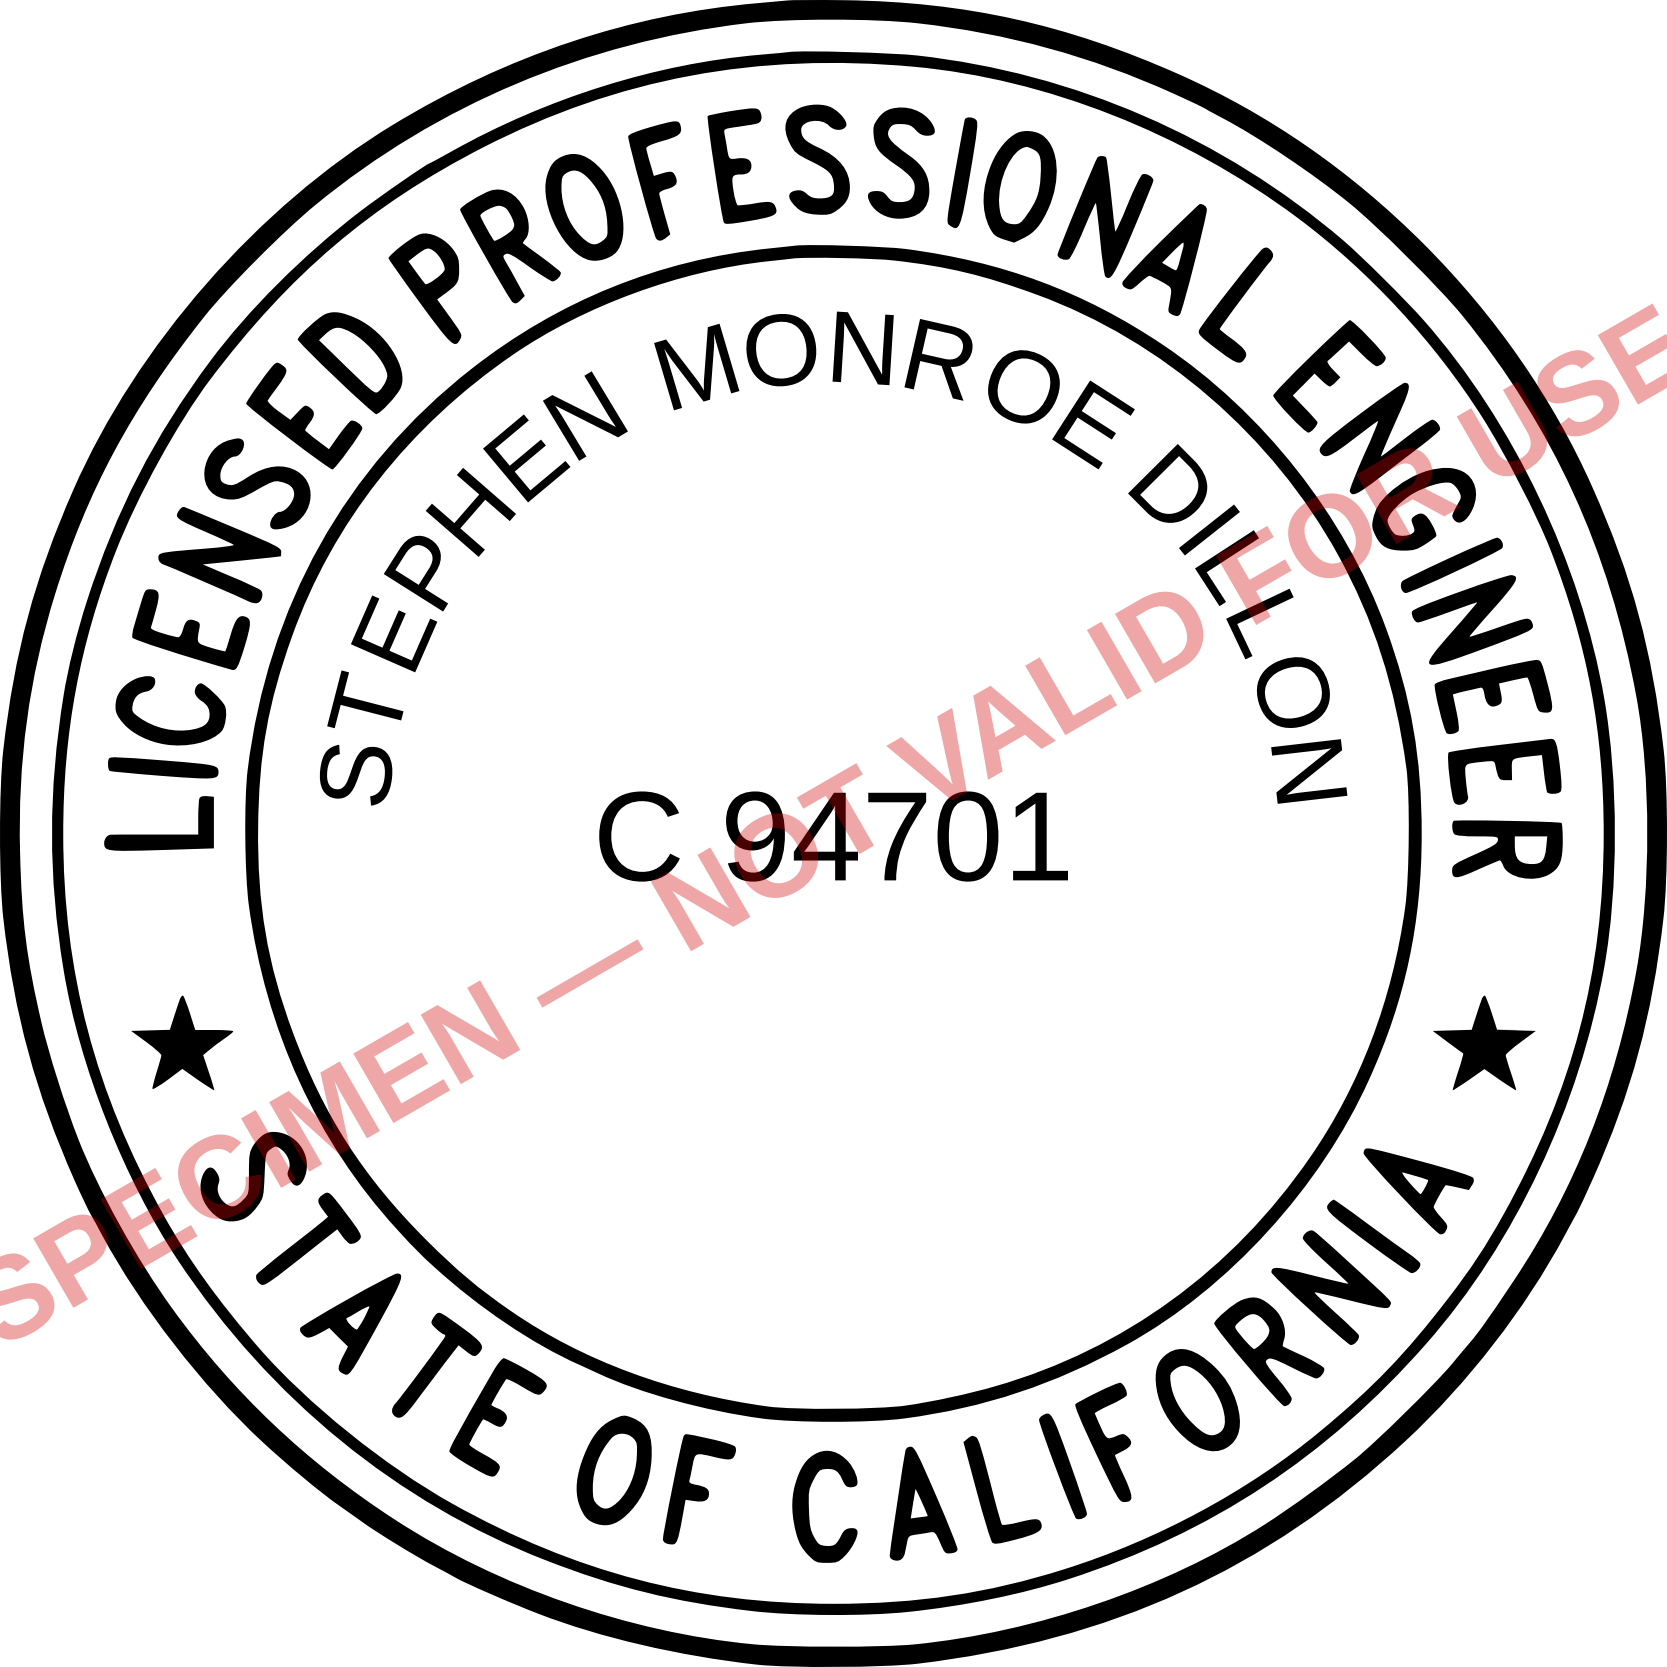

LICENSED PROFESSIONAL ENGINEER
STEPHEN MONROE DILLON
C 94701
STATE OF CALIFORNIA
SPECIMEN — NOT VALID FOR USE