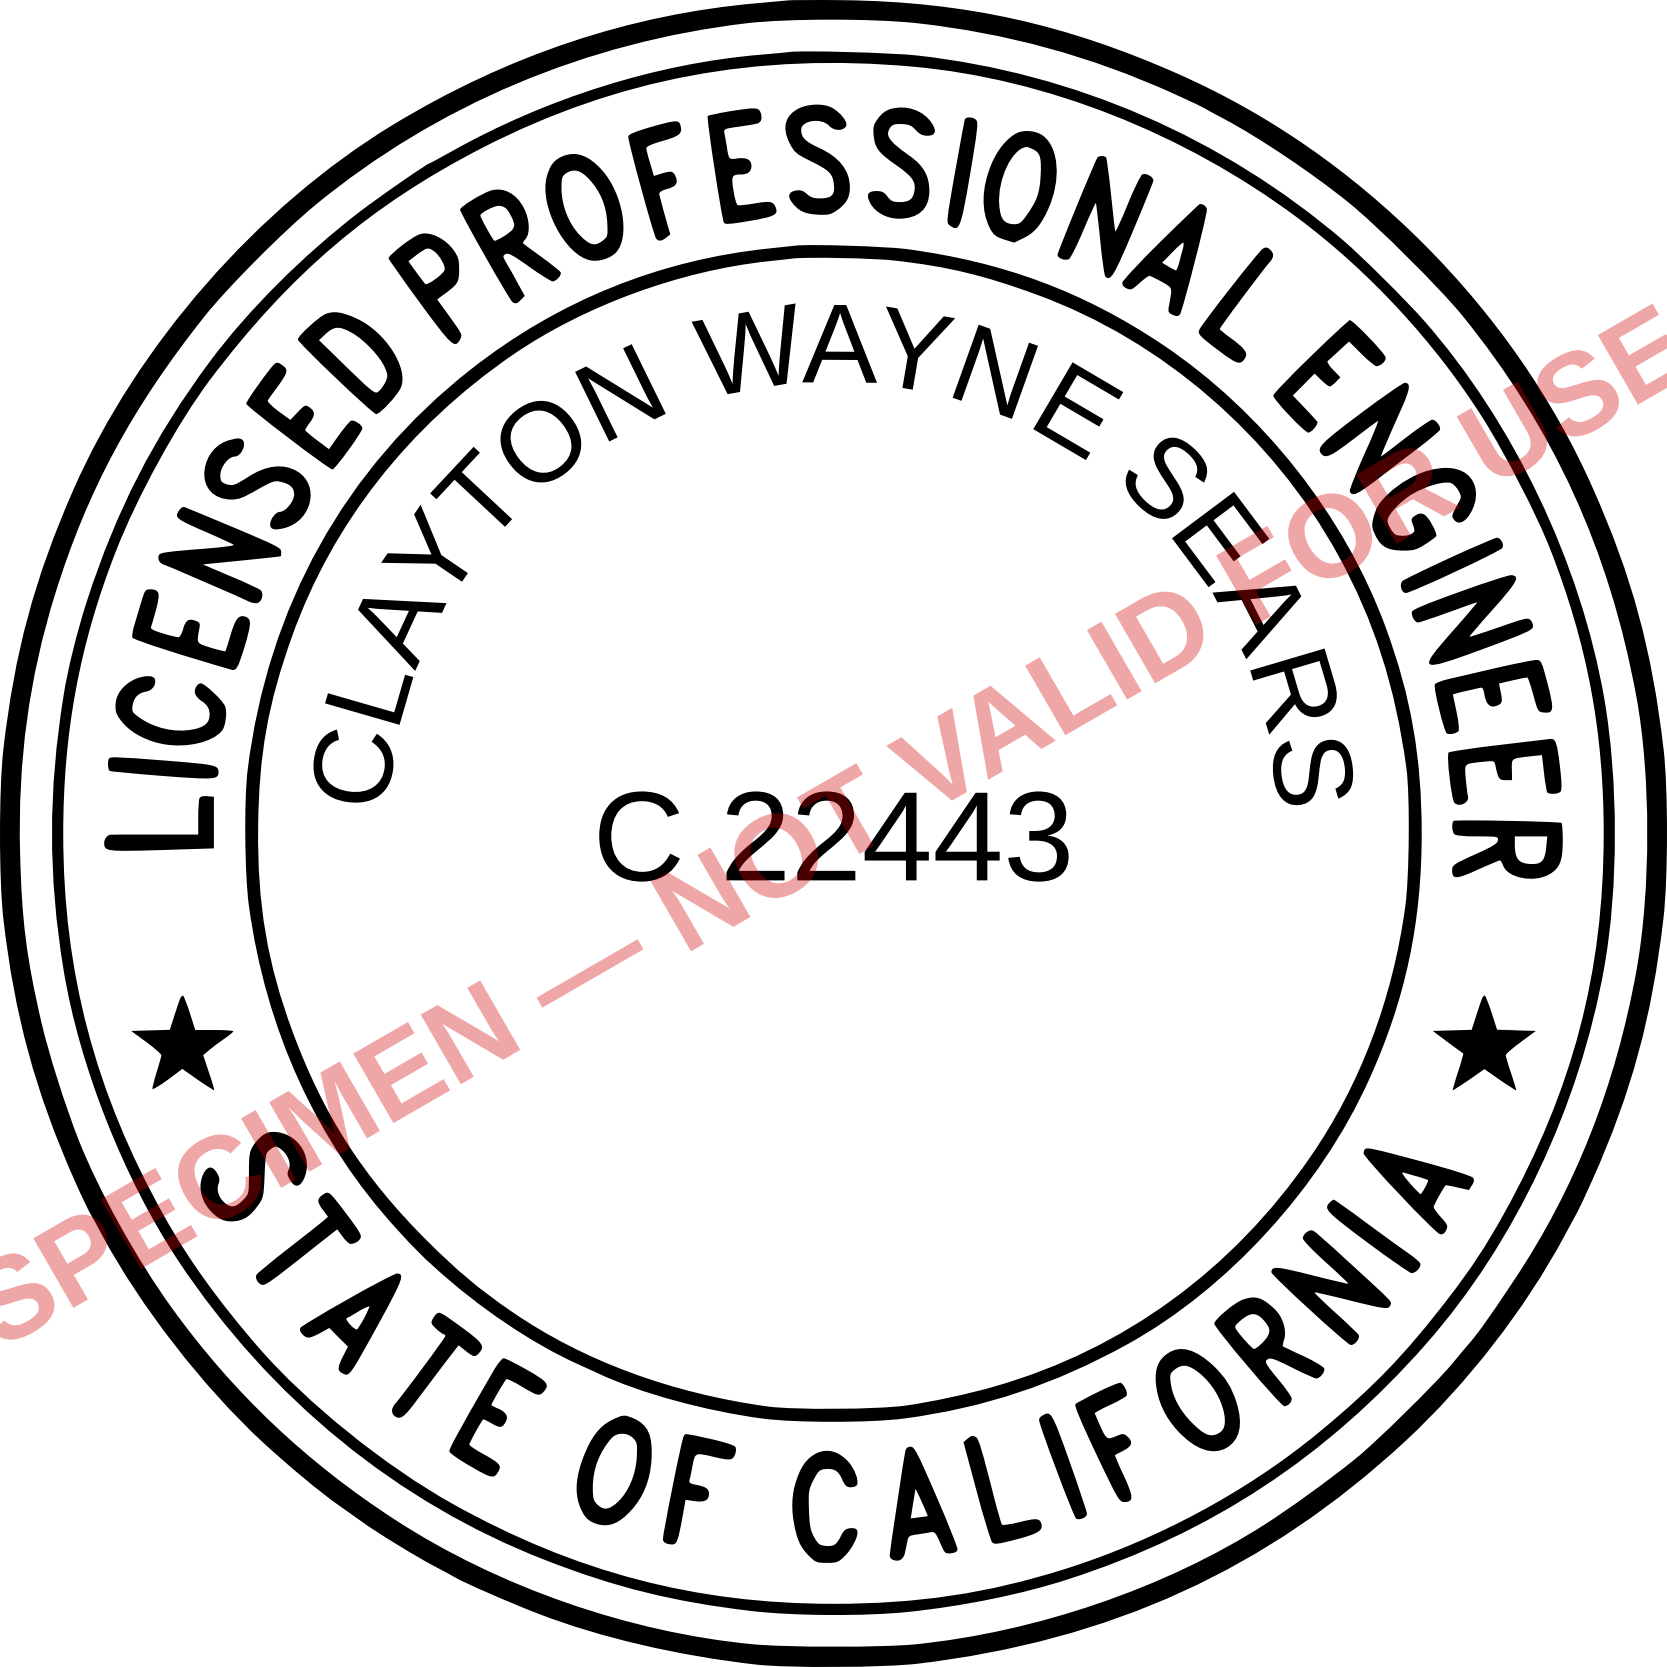

LICENSED PROFESSIONAL ENGINEER
CLAYTON WAYNE SEARS
C 22443
STATE OF CALIFORNIA
SPECIMEN — NOT VALID FOR USE