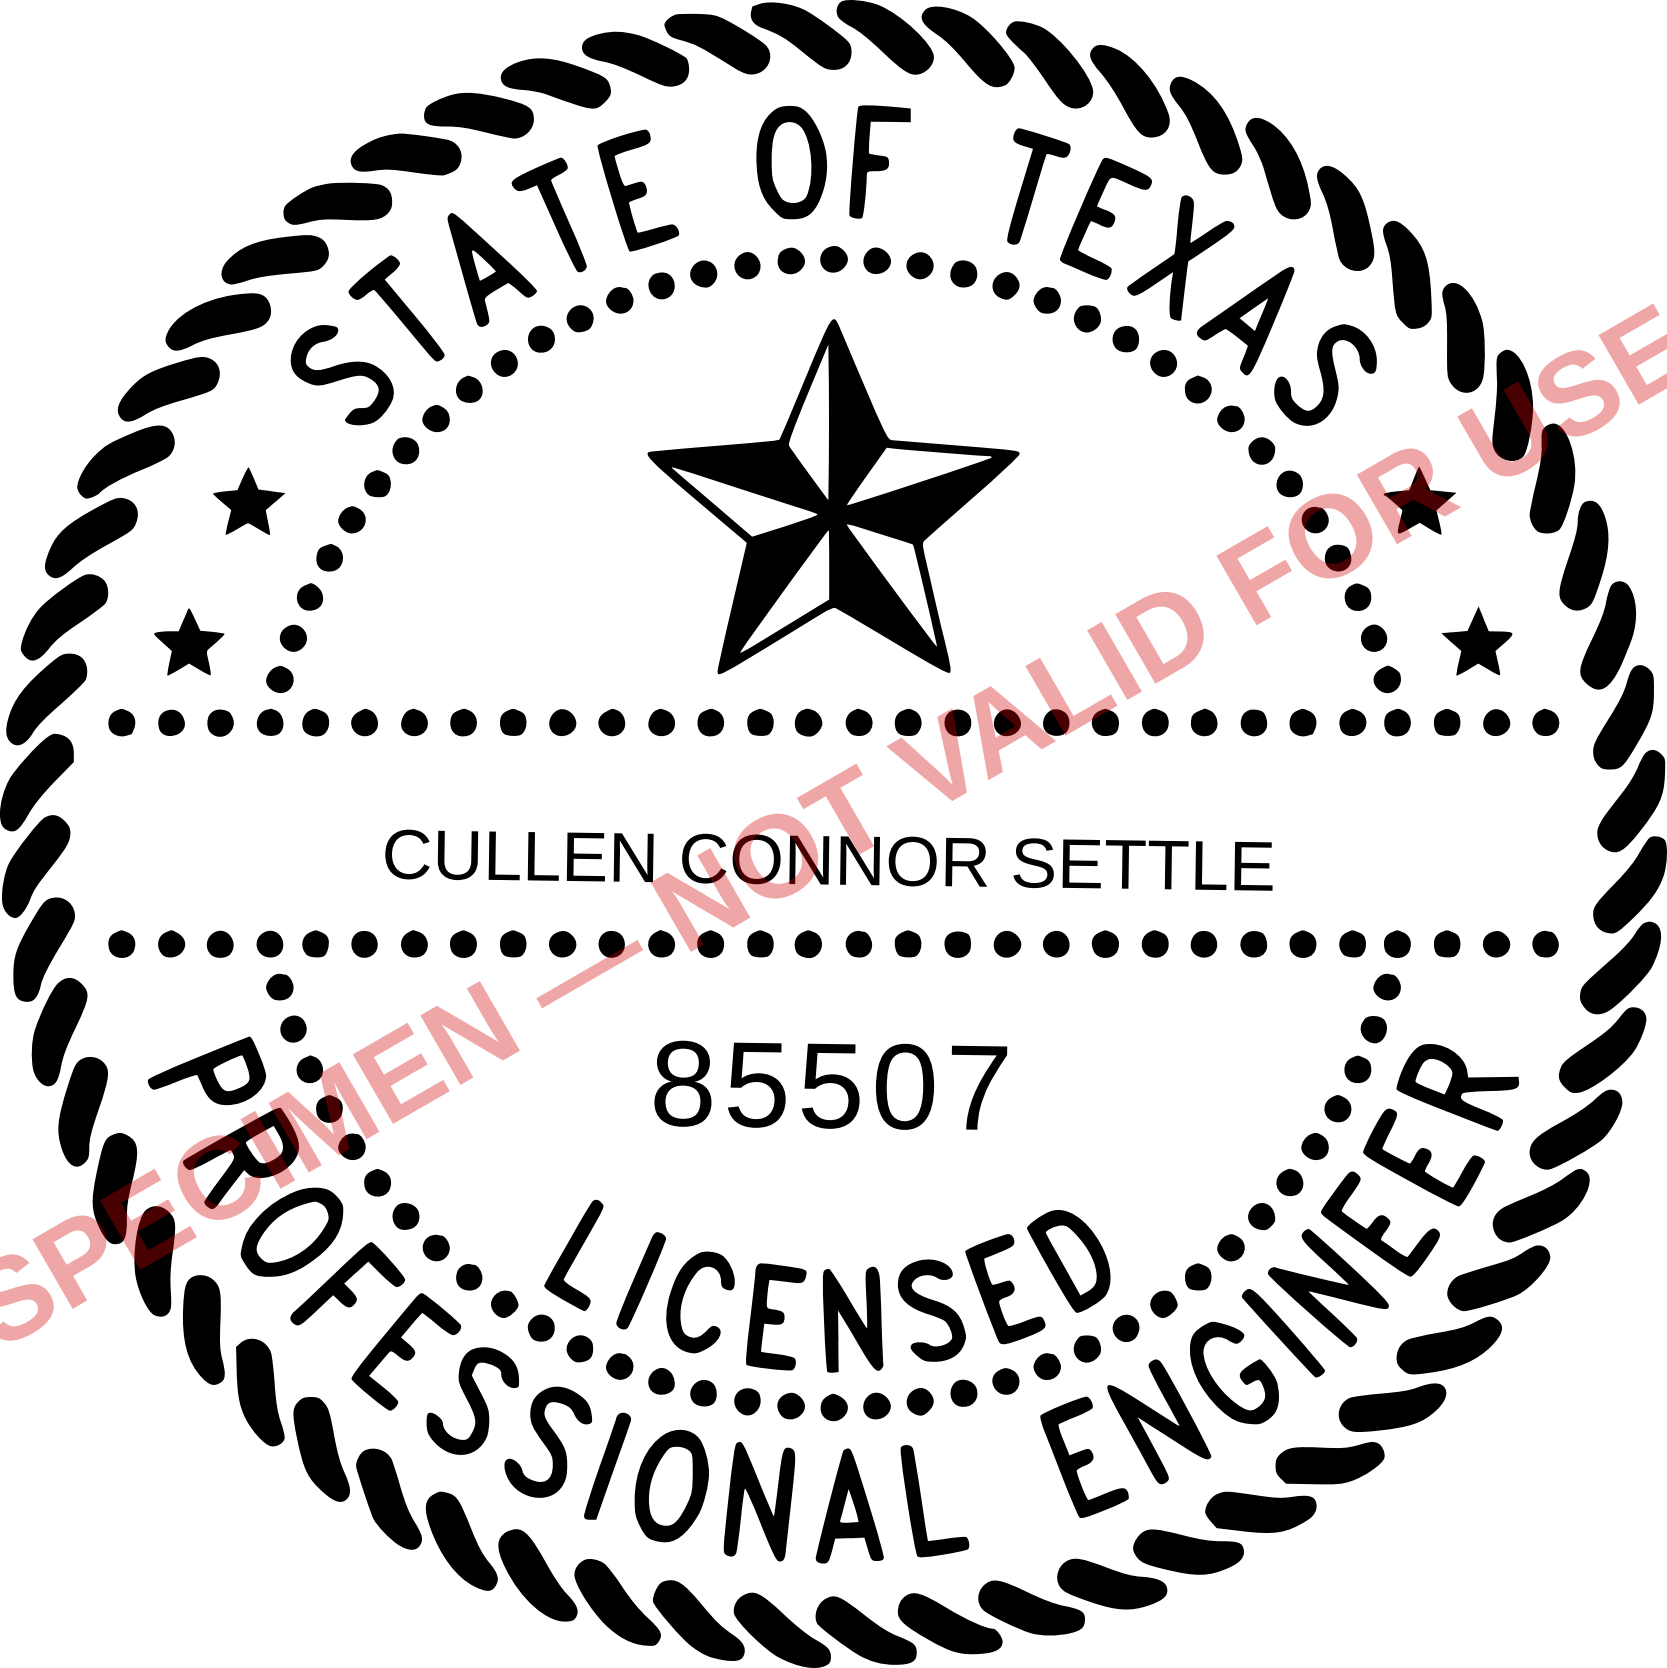

STATE OF TEXAS
CULLEN CONNOR SETTLE
85507
LICENSED
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE