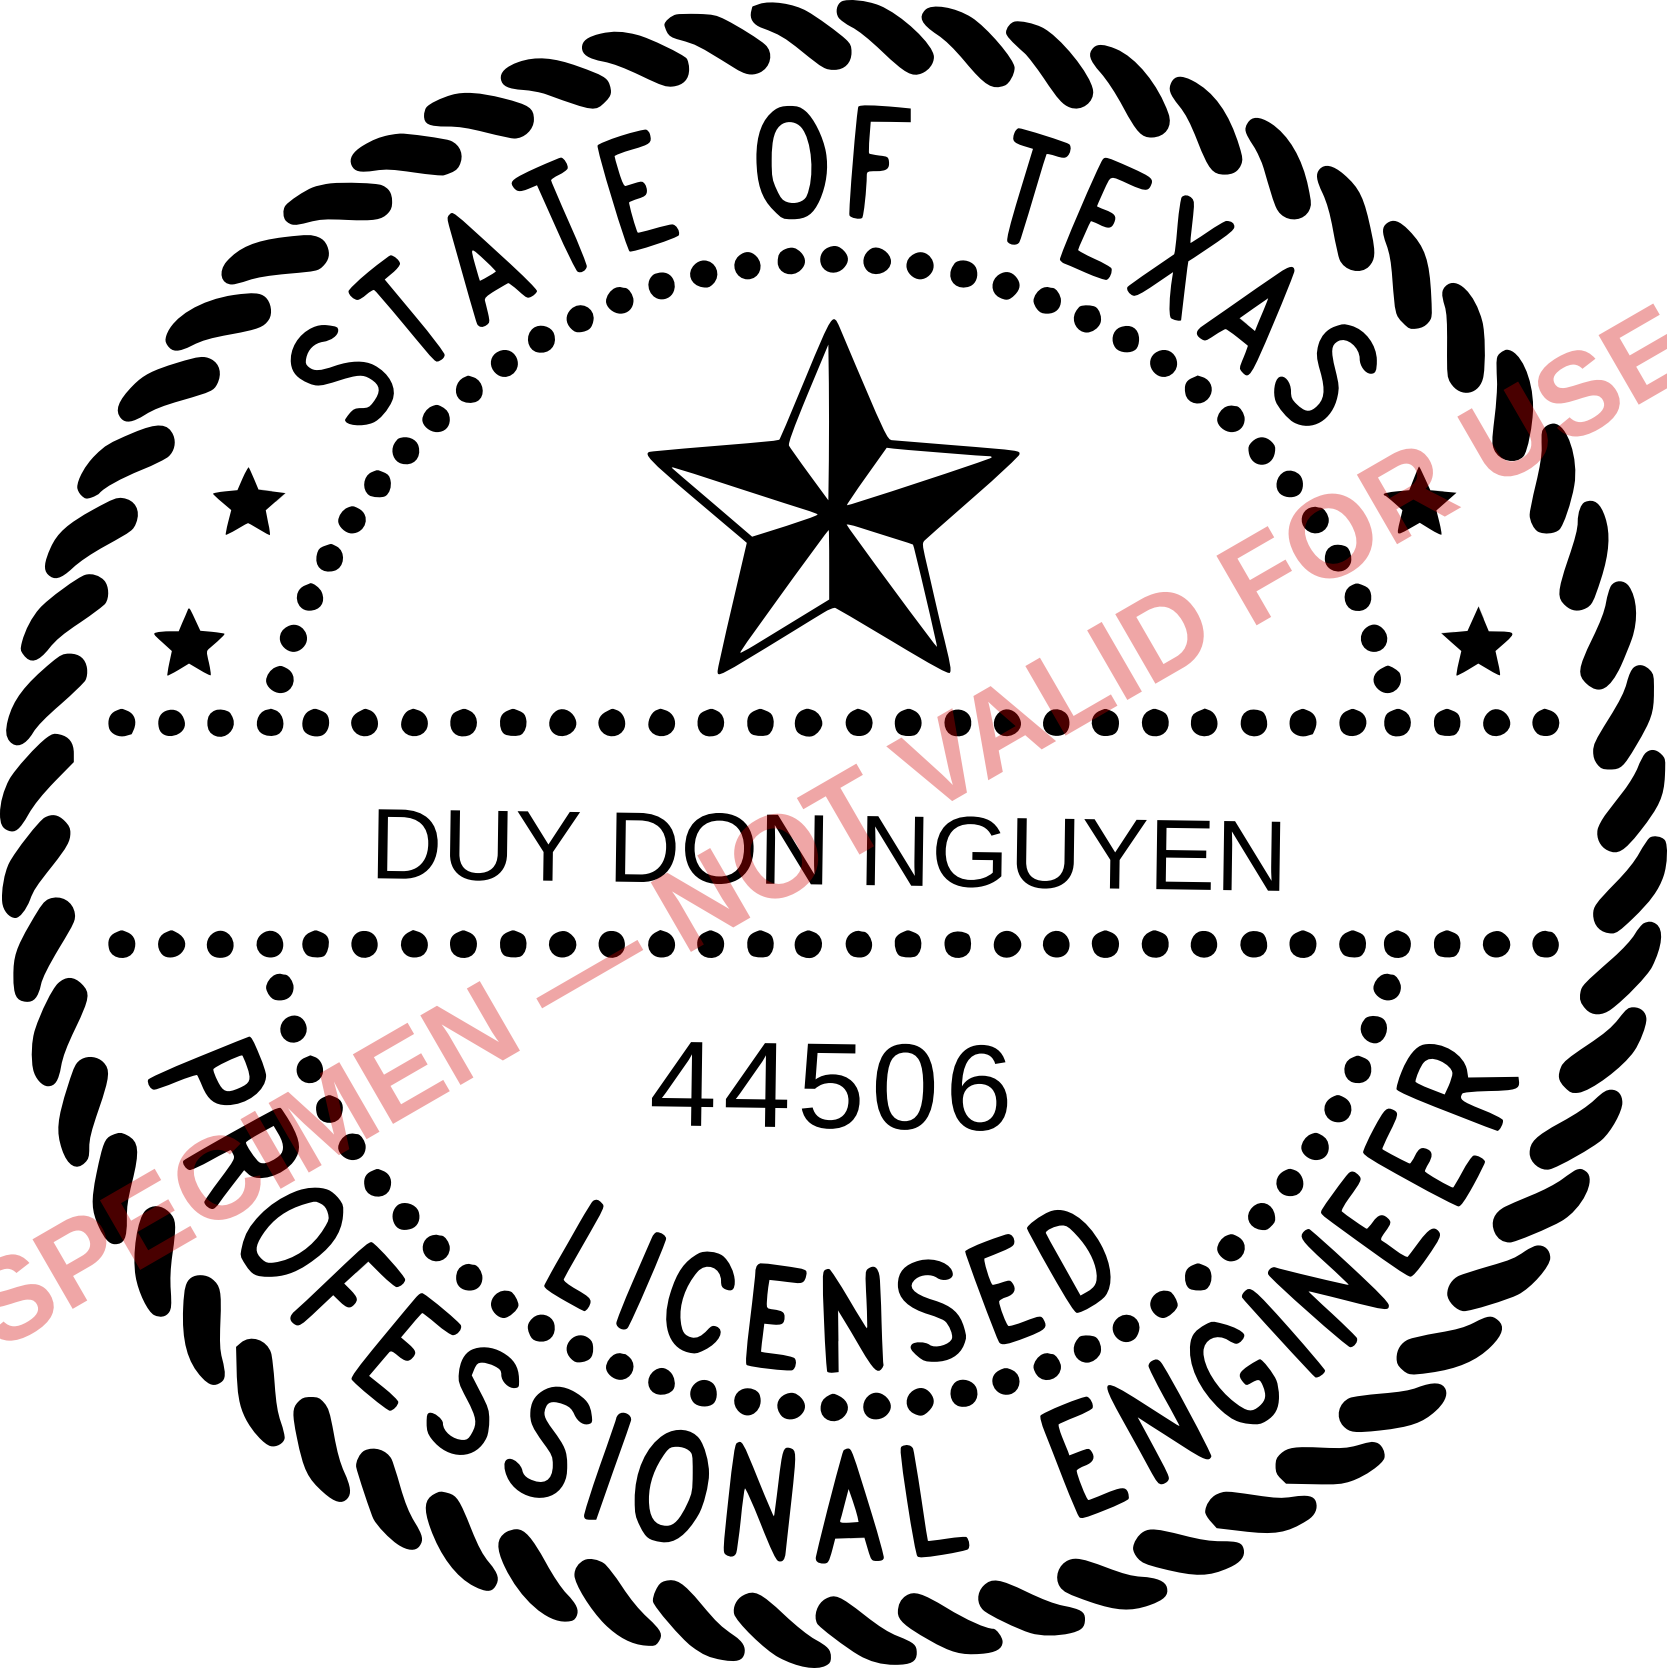

STATE OF TEXAS
DUY DON NGUYEN
44506
LICENSED
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE