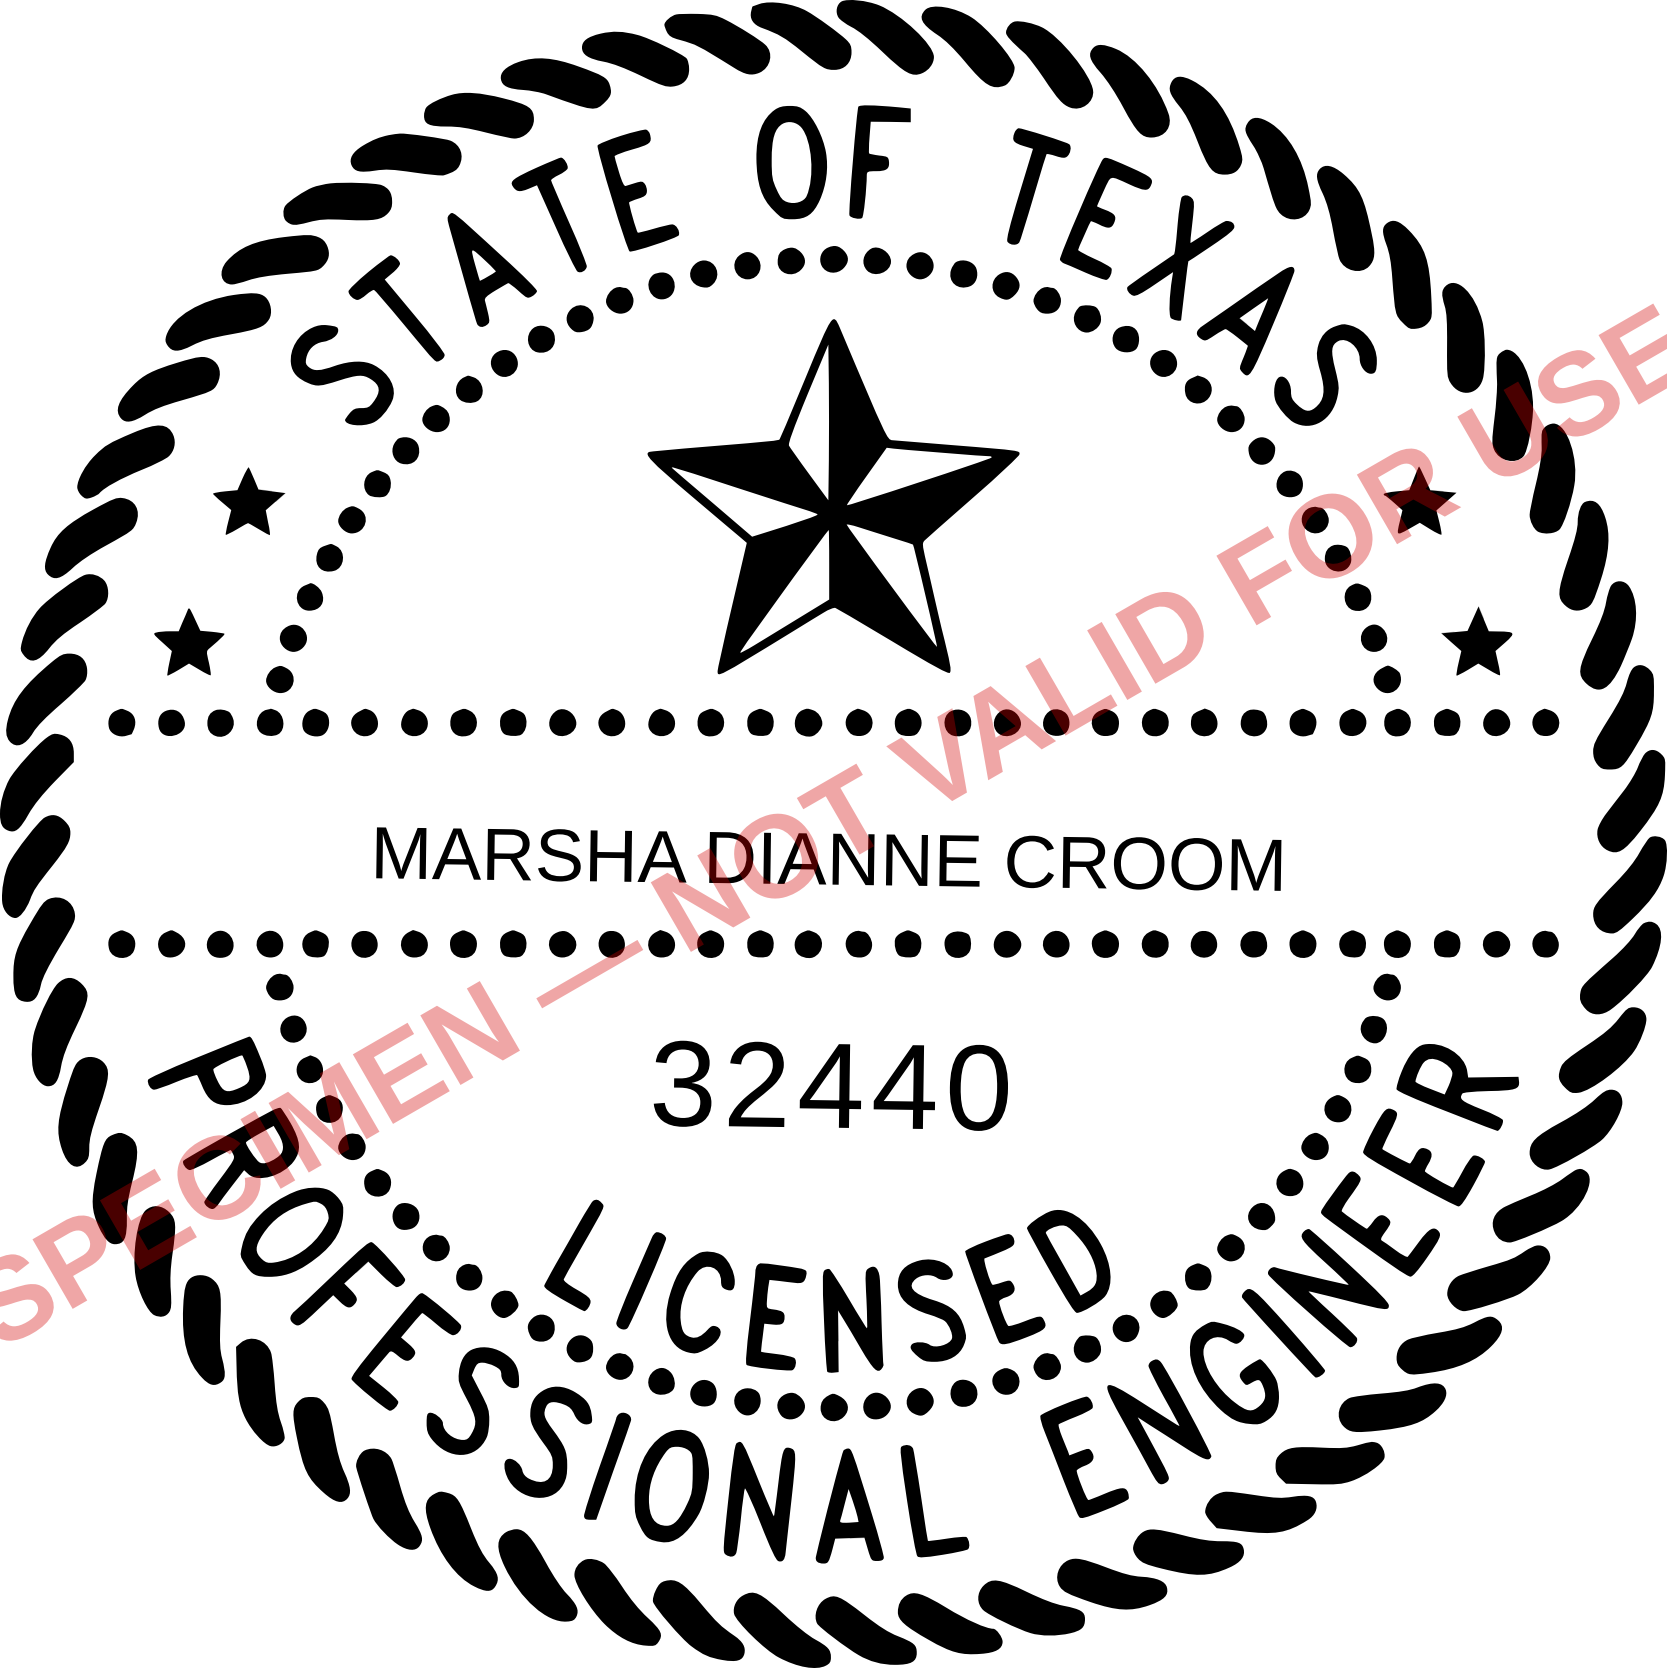

STATE OF TEXAS
MARSHA DIANNE CROOM
32440
LICENSED
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE