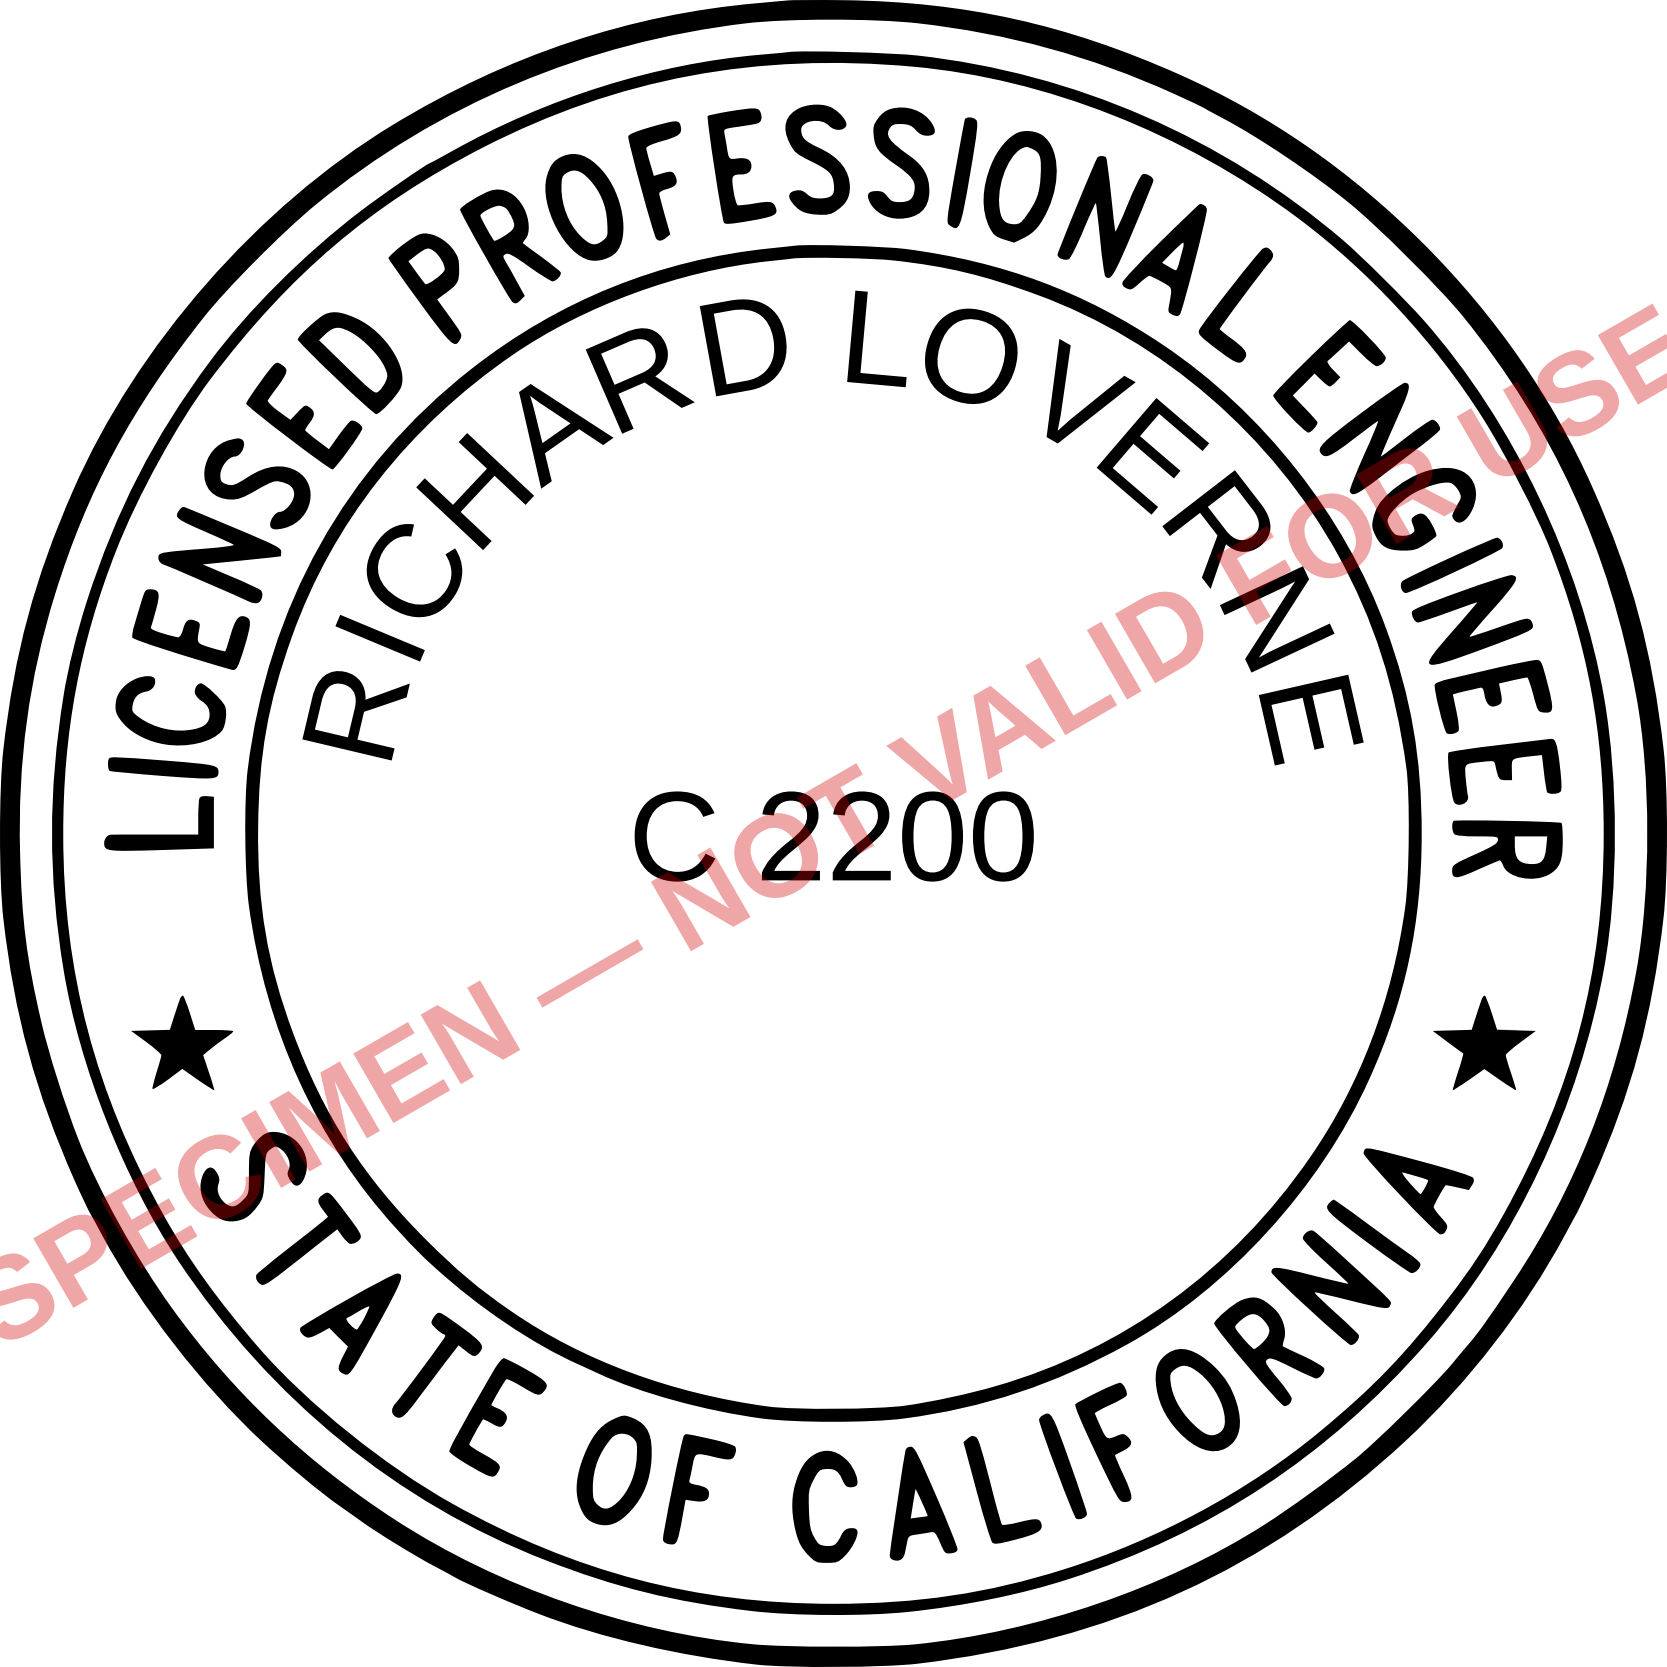

LICENSED PROFESSIONAL ENGINEER
RICHARD LOVERNE
C 2200
STATE OF CALIFORNIA
SPECIMEN — NOT VALID FOR USE