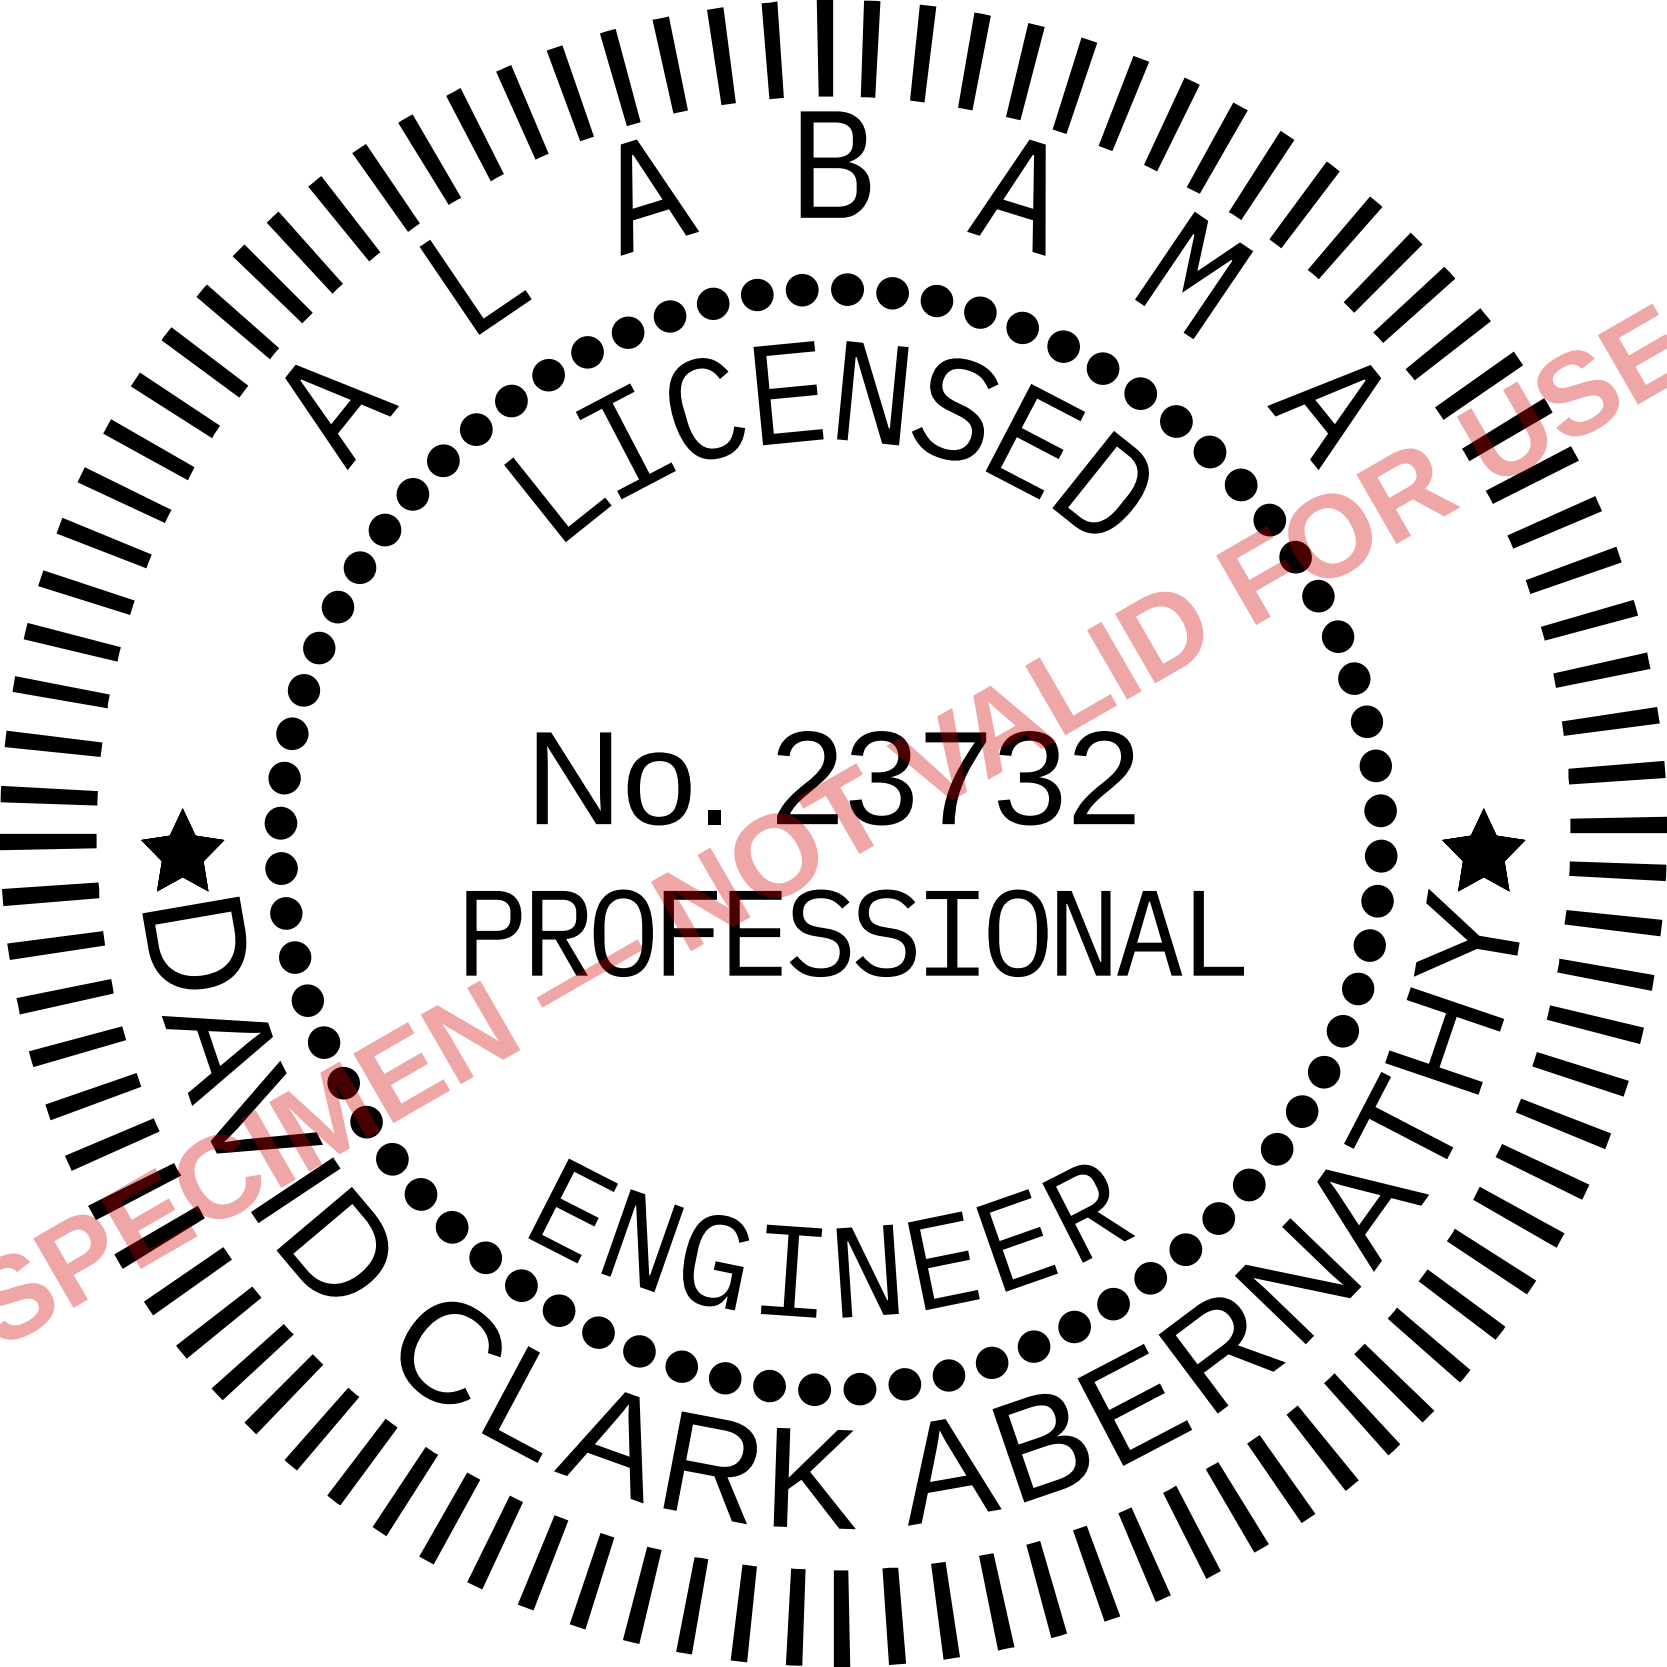

ALABAMA
LICENSED
No. 23732
PROFESSIONAL
ENGINEER
DAVID CLARK ABERNATHY
SPECIMEN — NOT VALID FOR USE