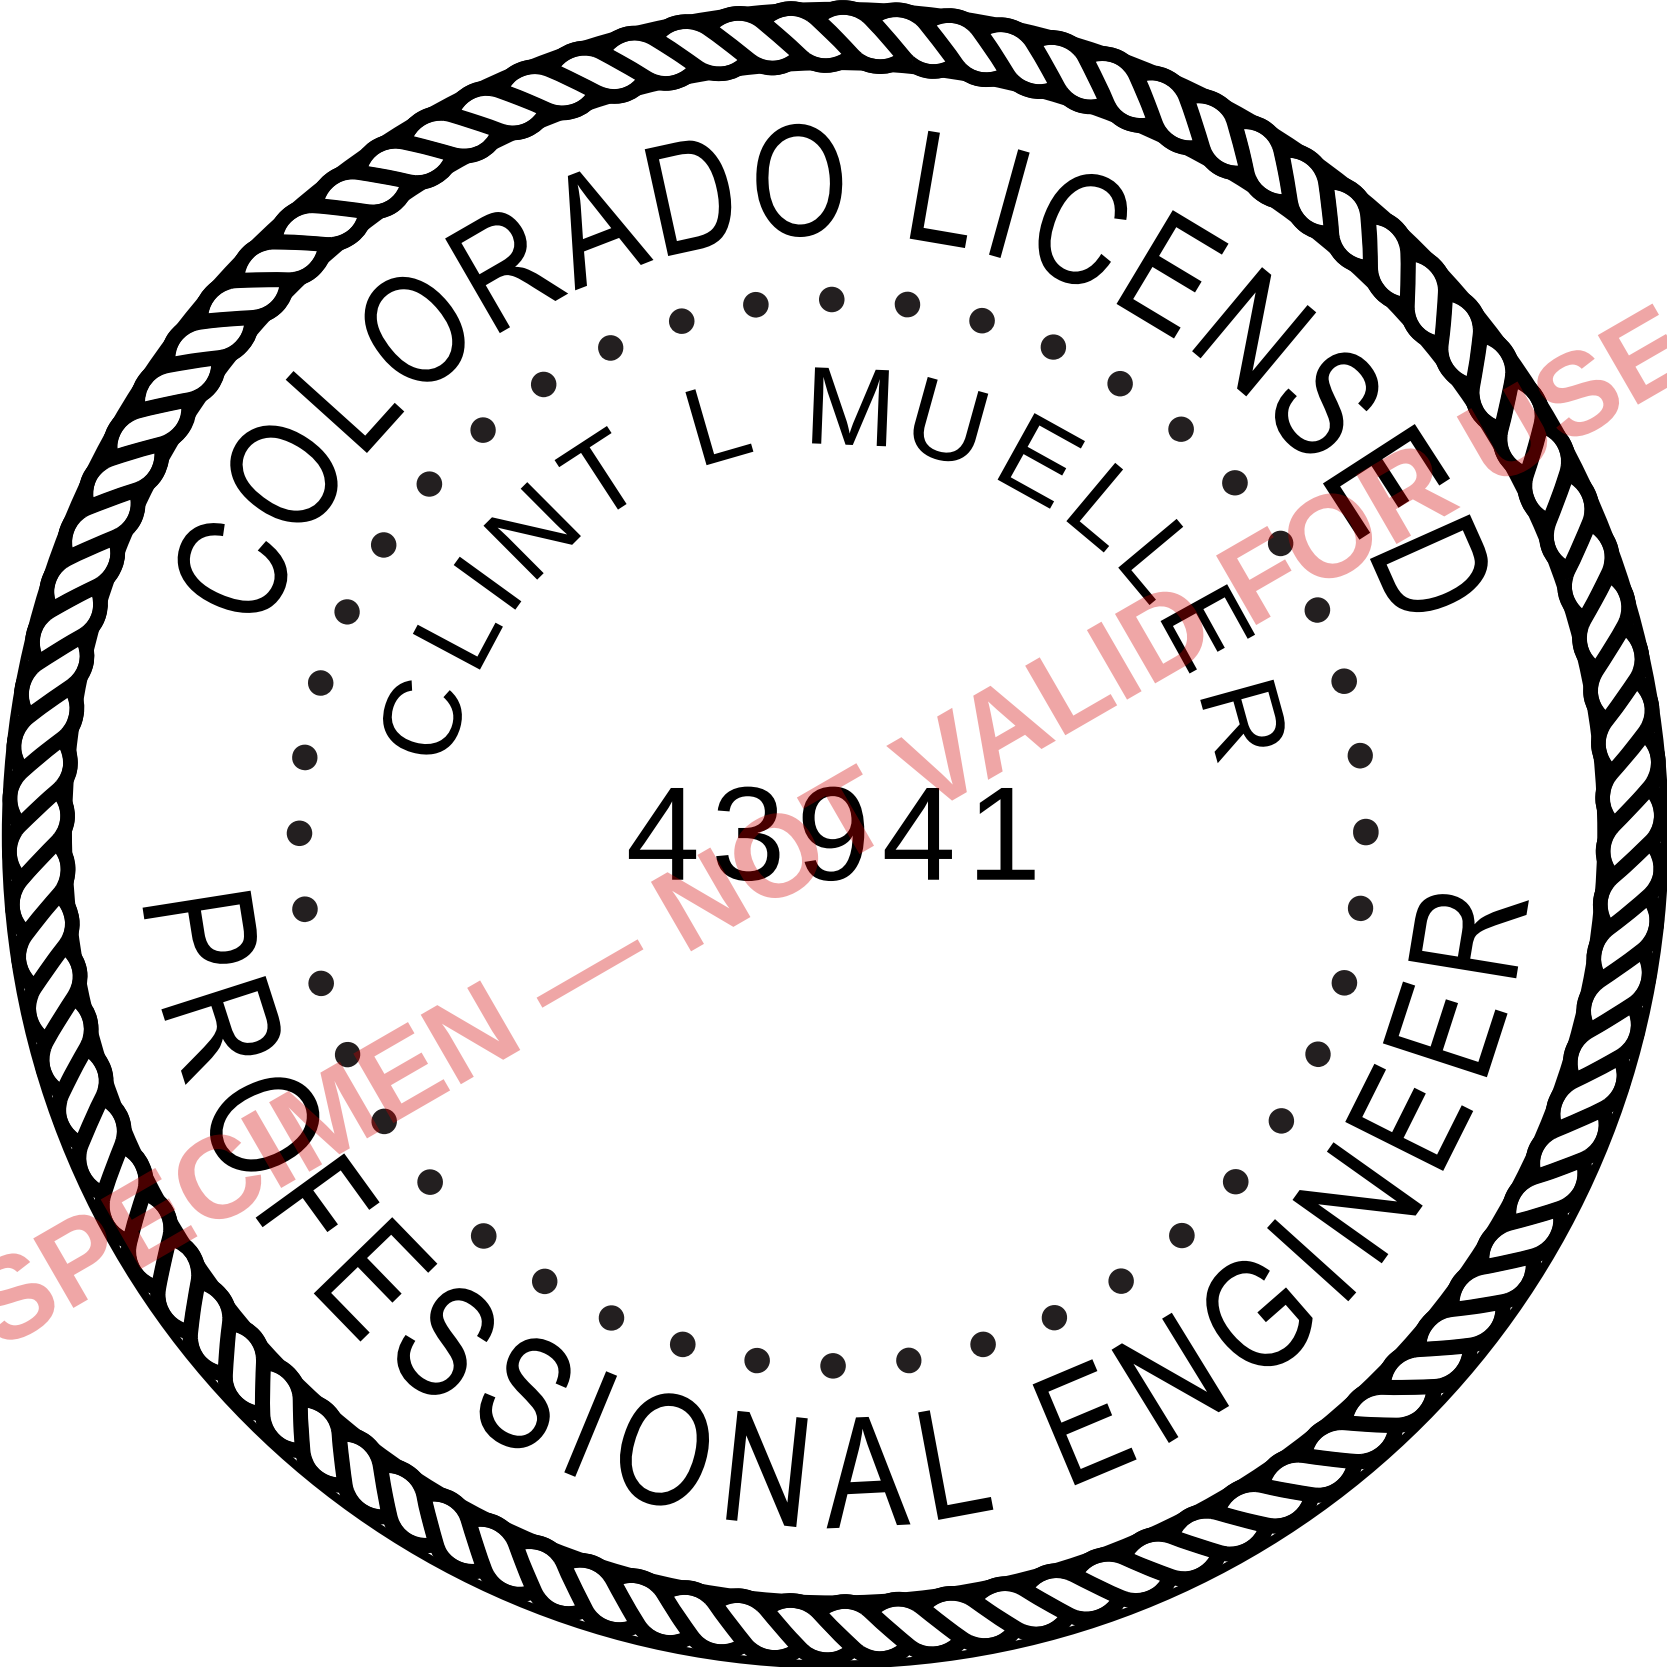

COLORADO LICENSED
CLINT L MUELLER
43941
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE