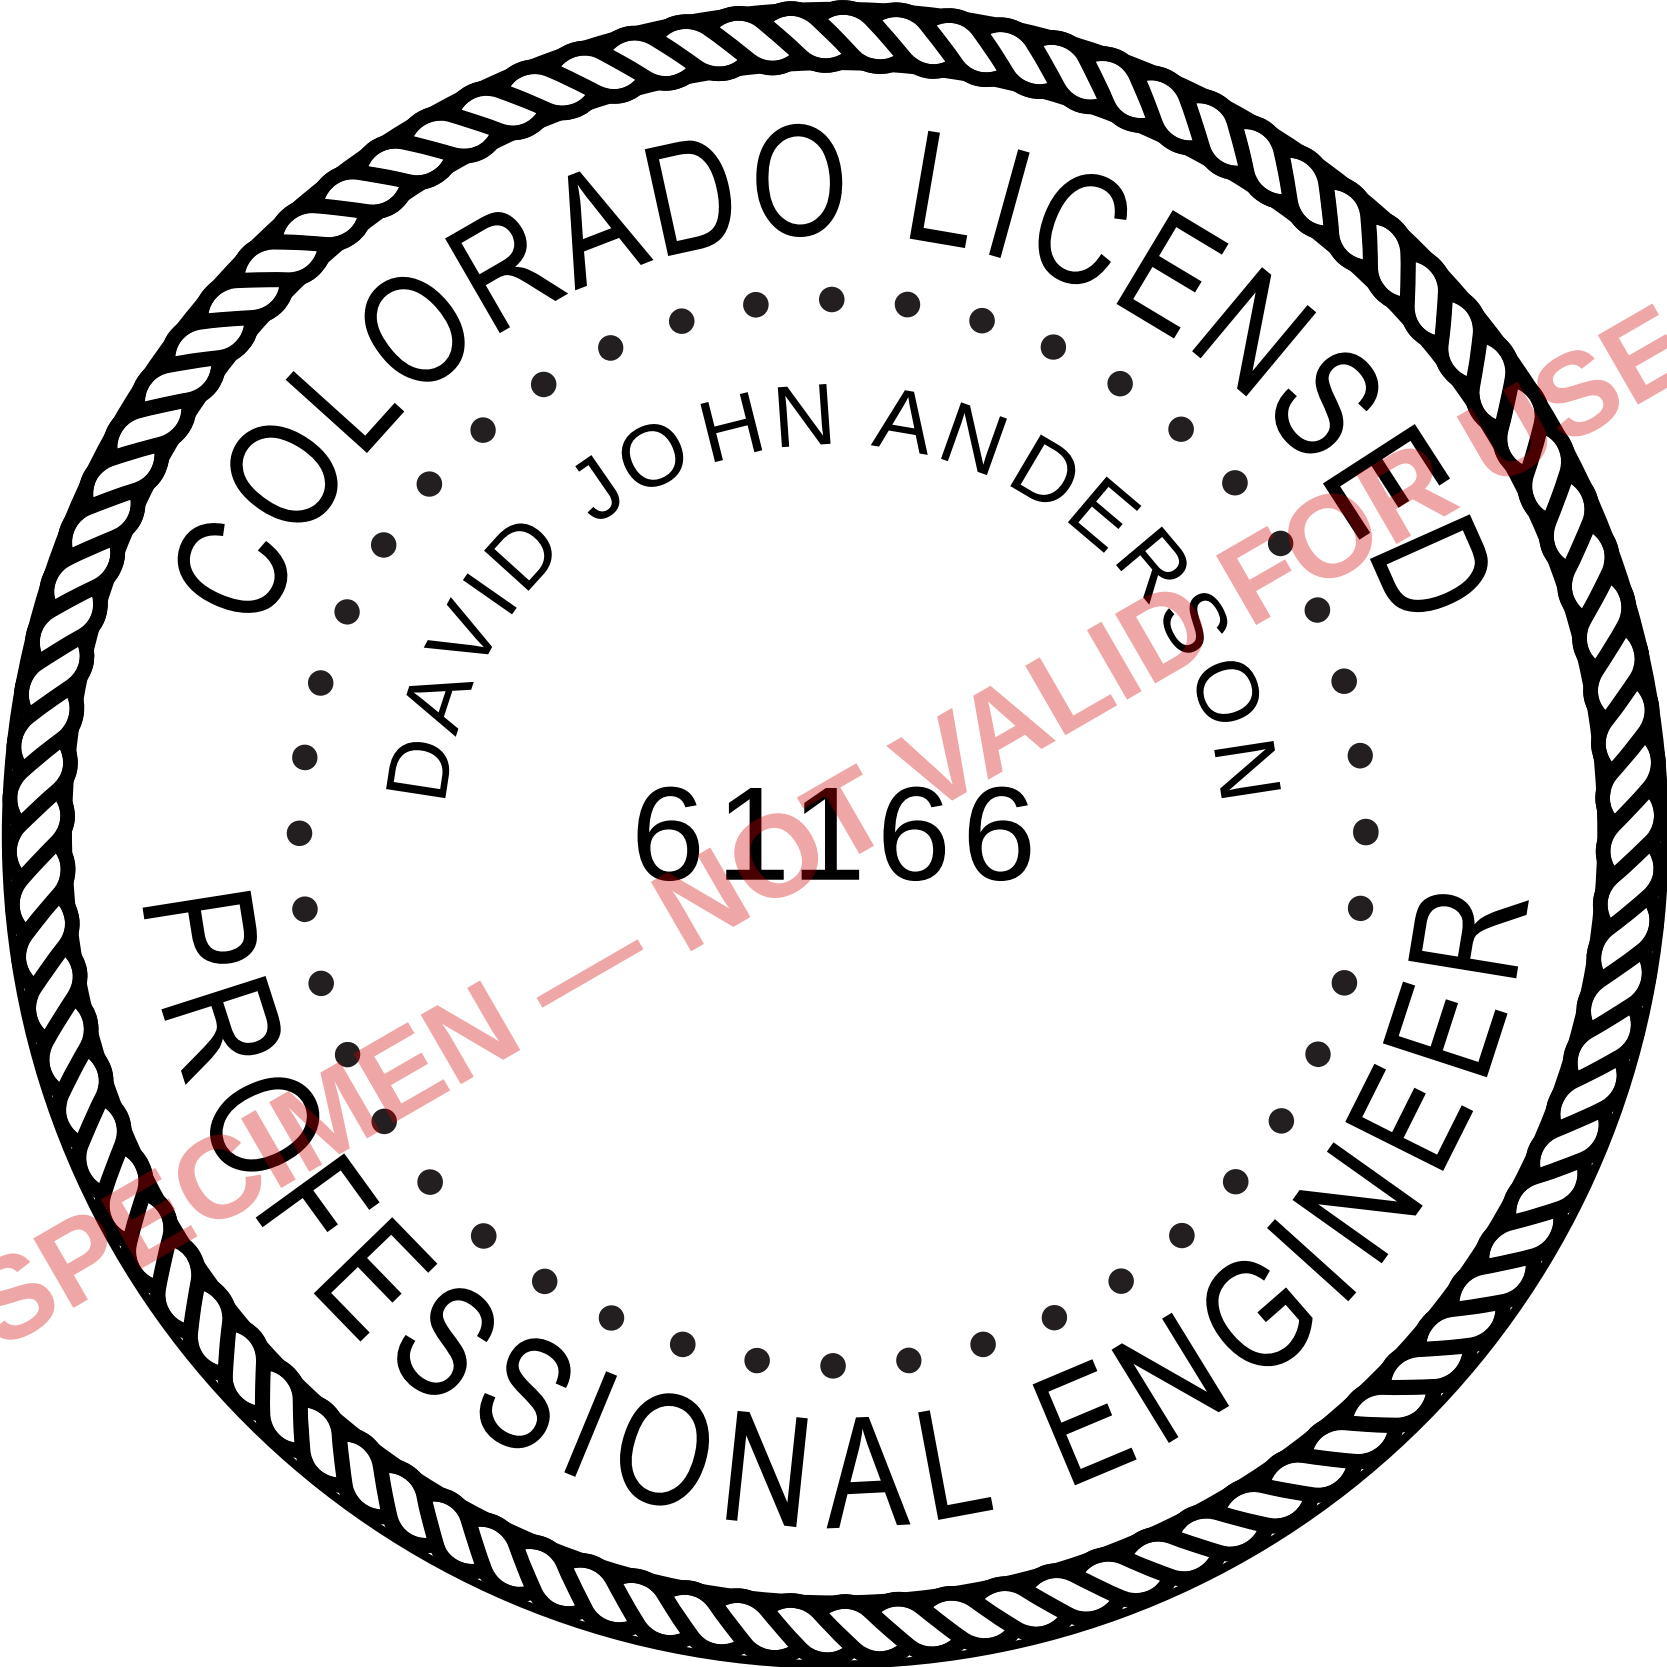

COLORADO LICENSED
DAVID JOHN ANDERSON
61166
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE