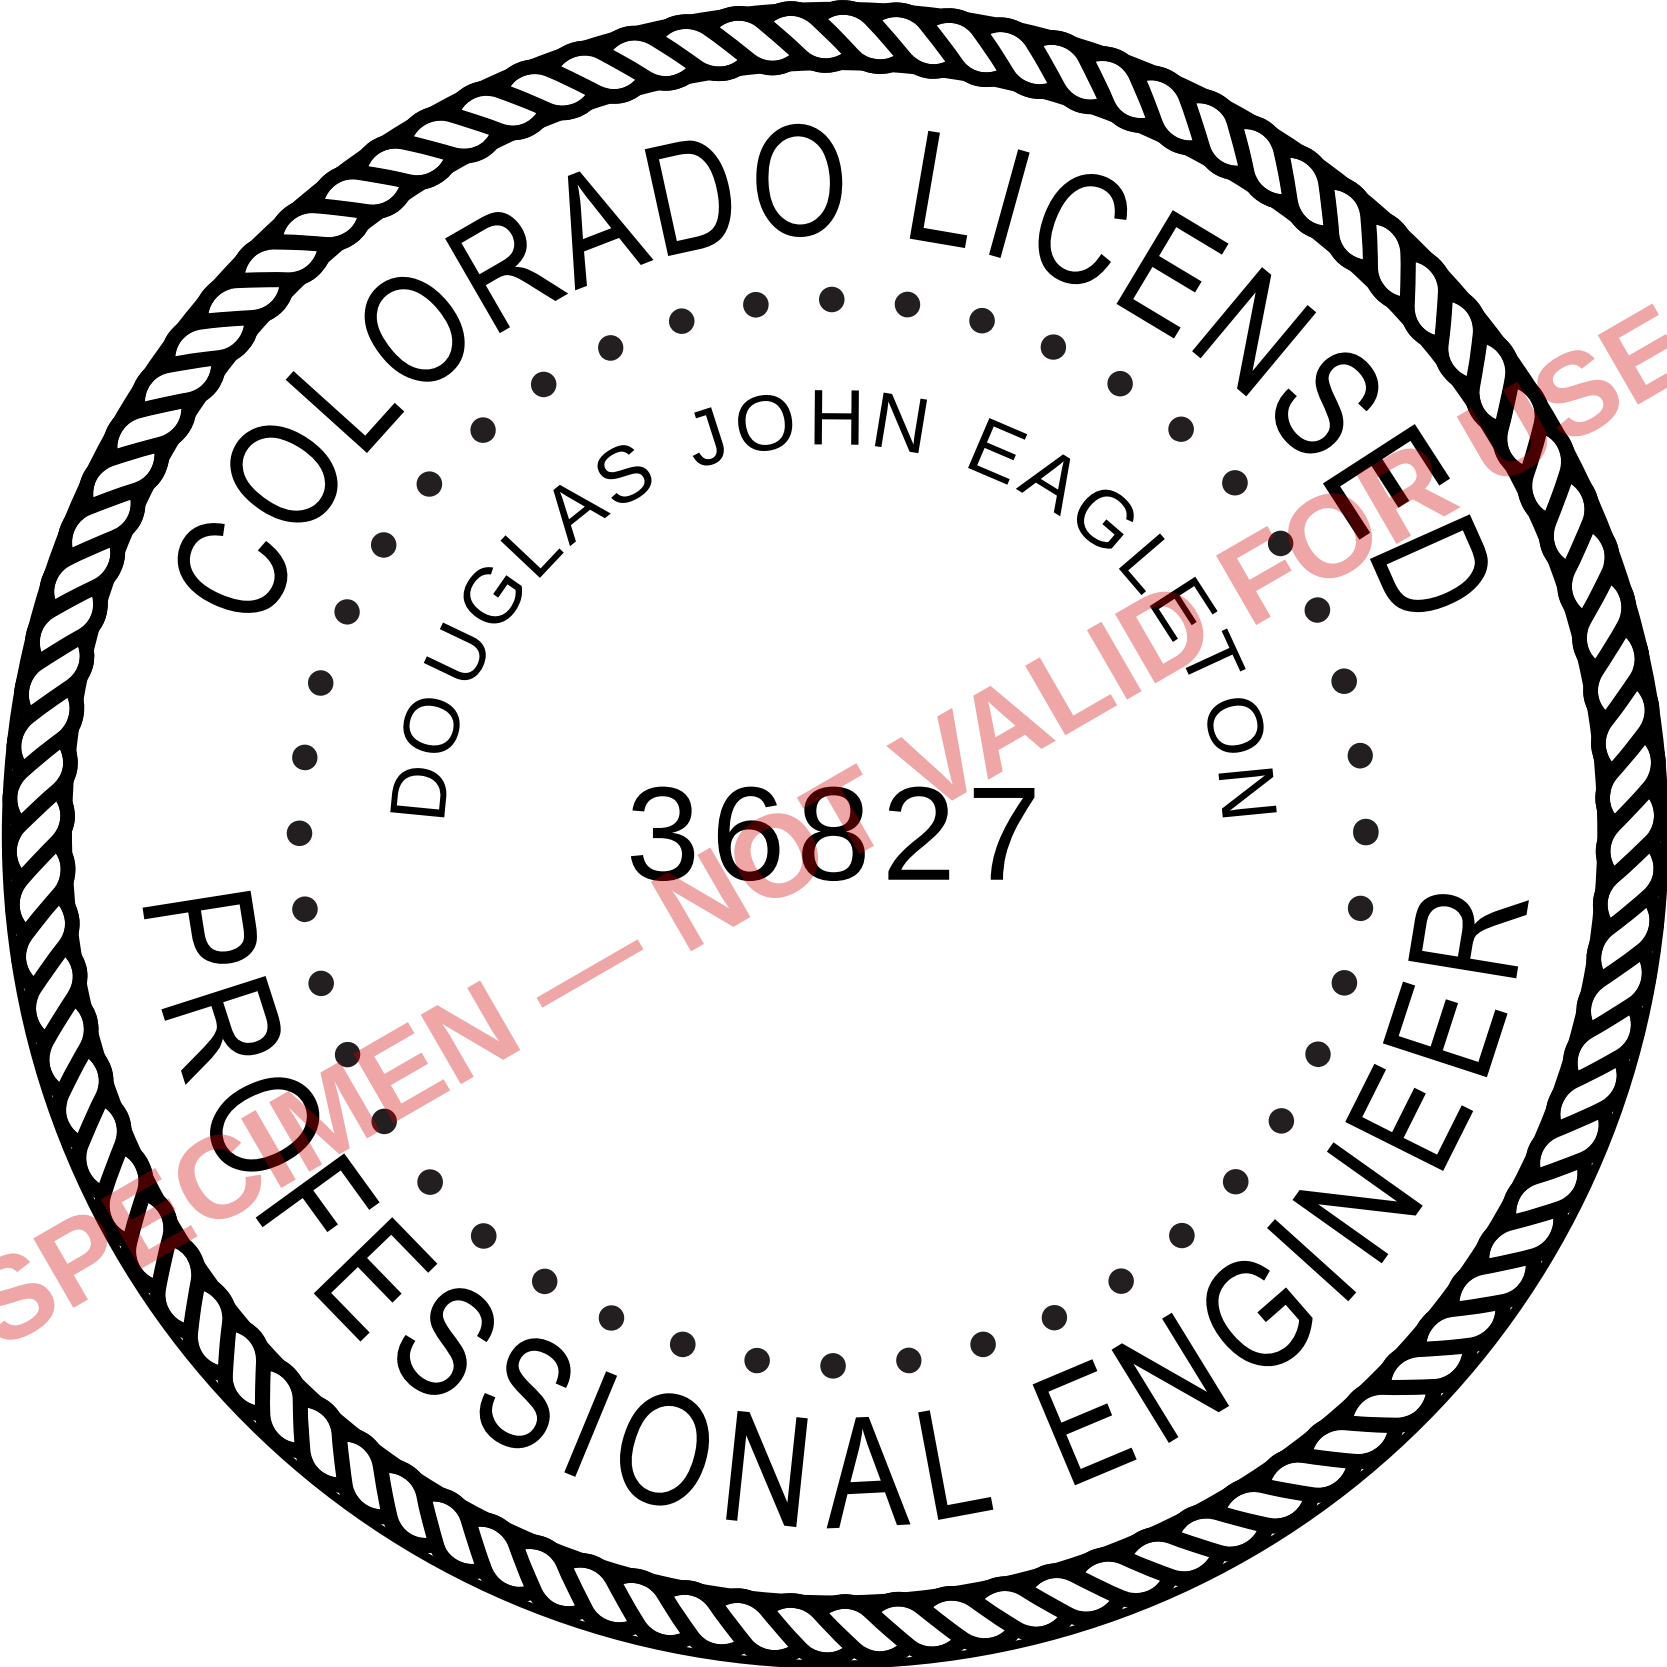

COLORADO LICENSED
DOUGLAS JOHN EAGLETON
36827
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE