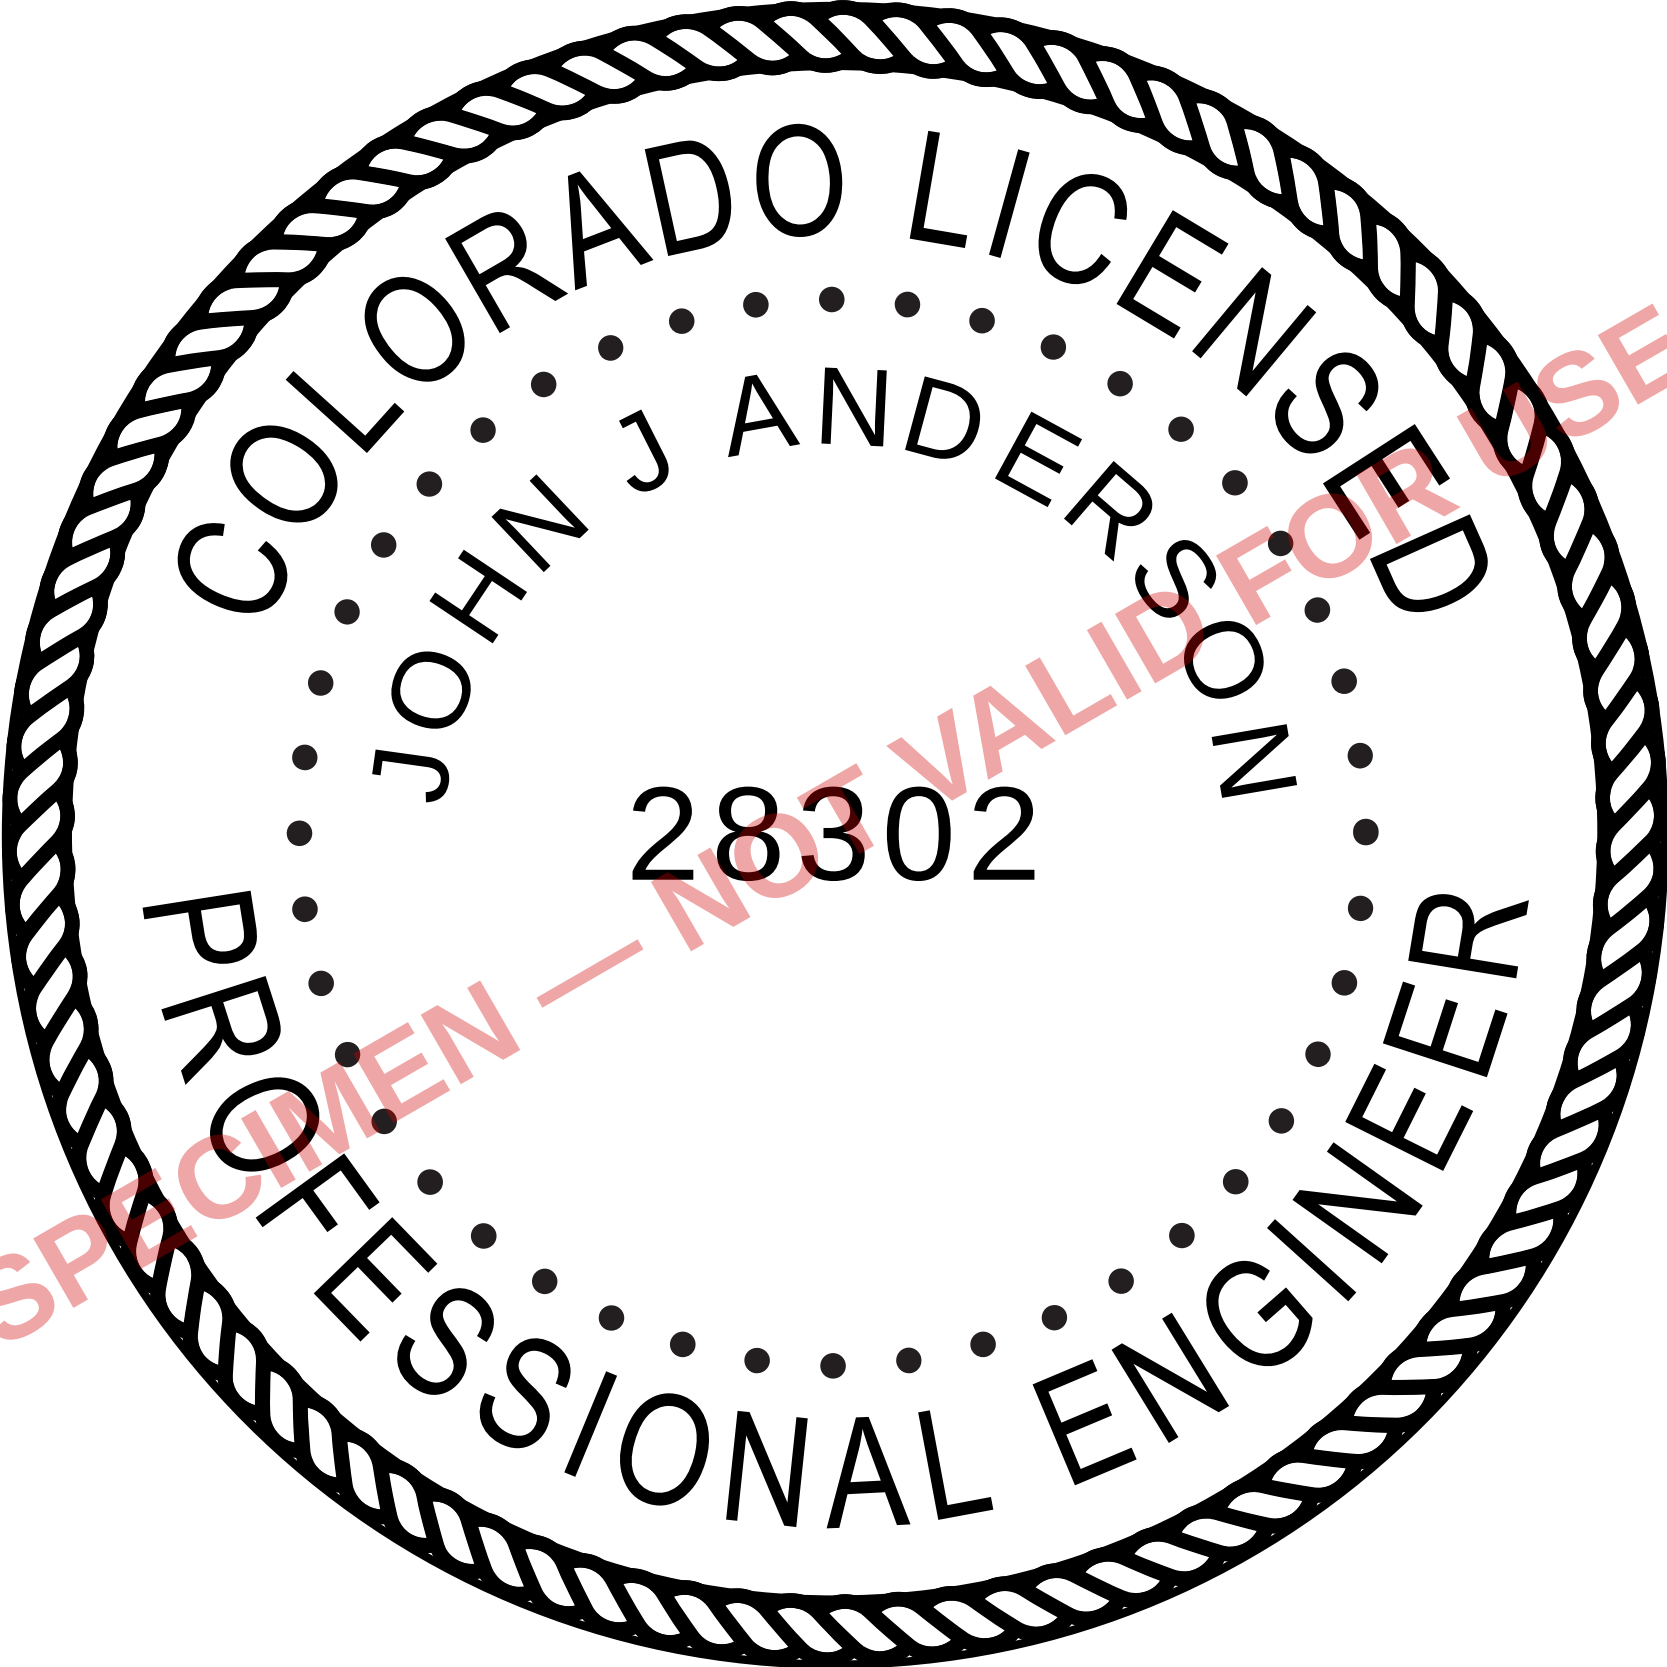

COLORADO LICENSED
JOHN J ANDERSON
28302
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE