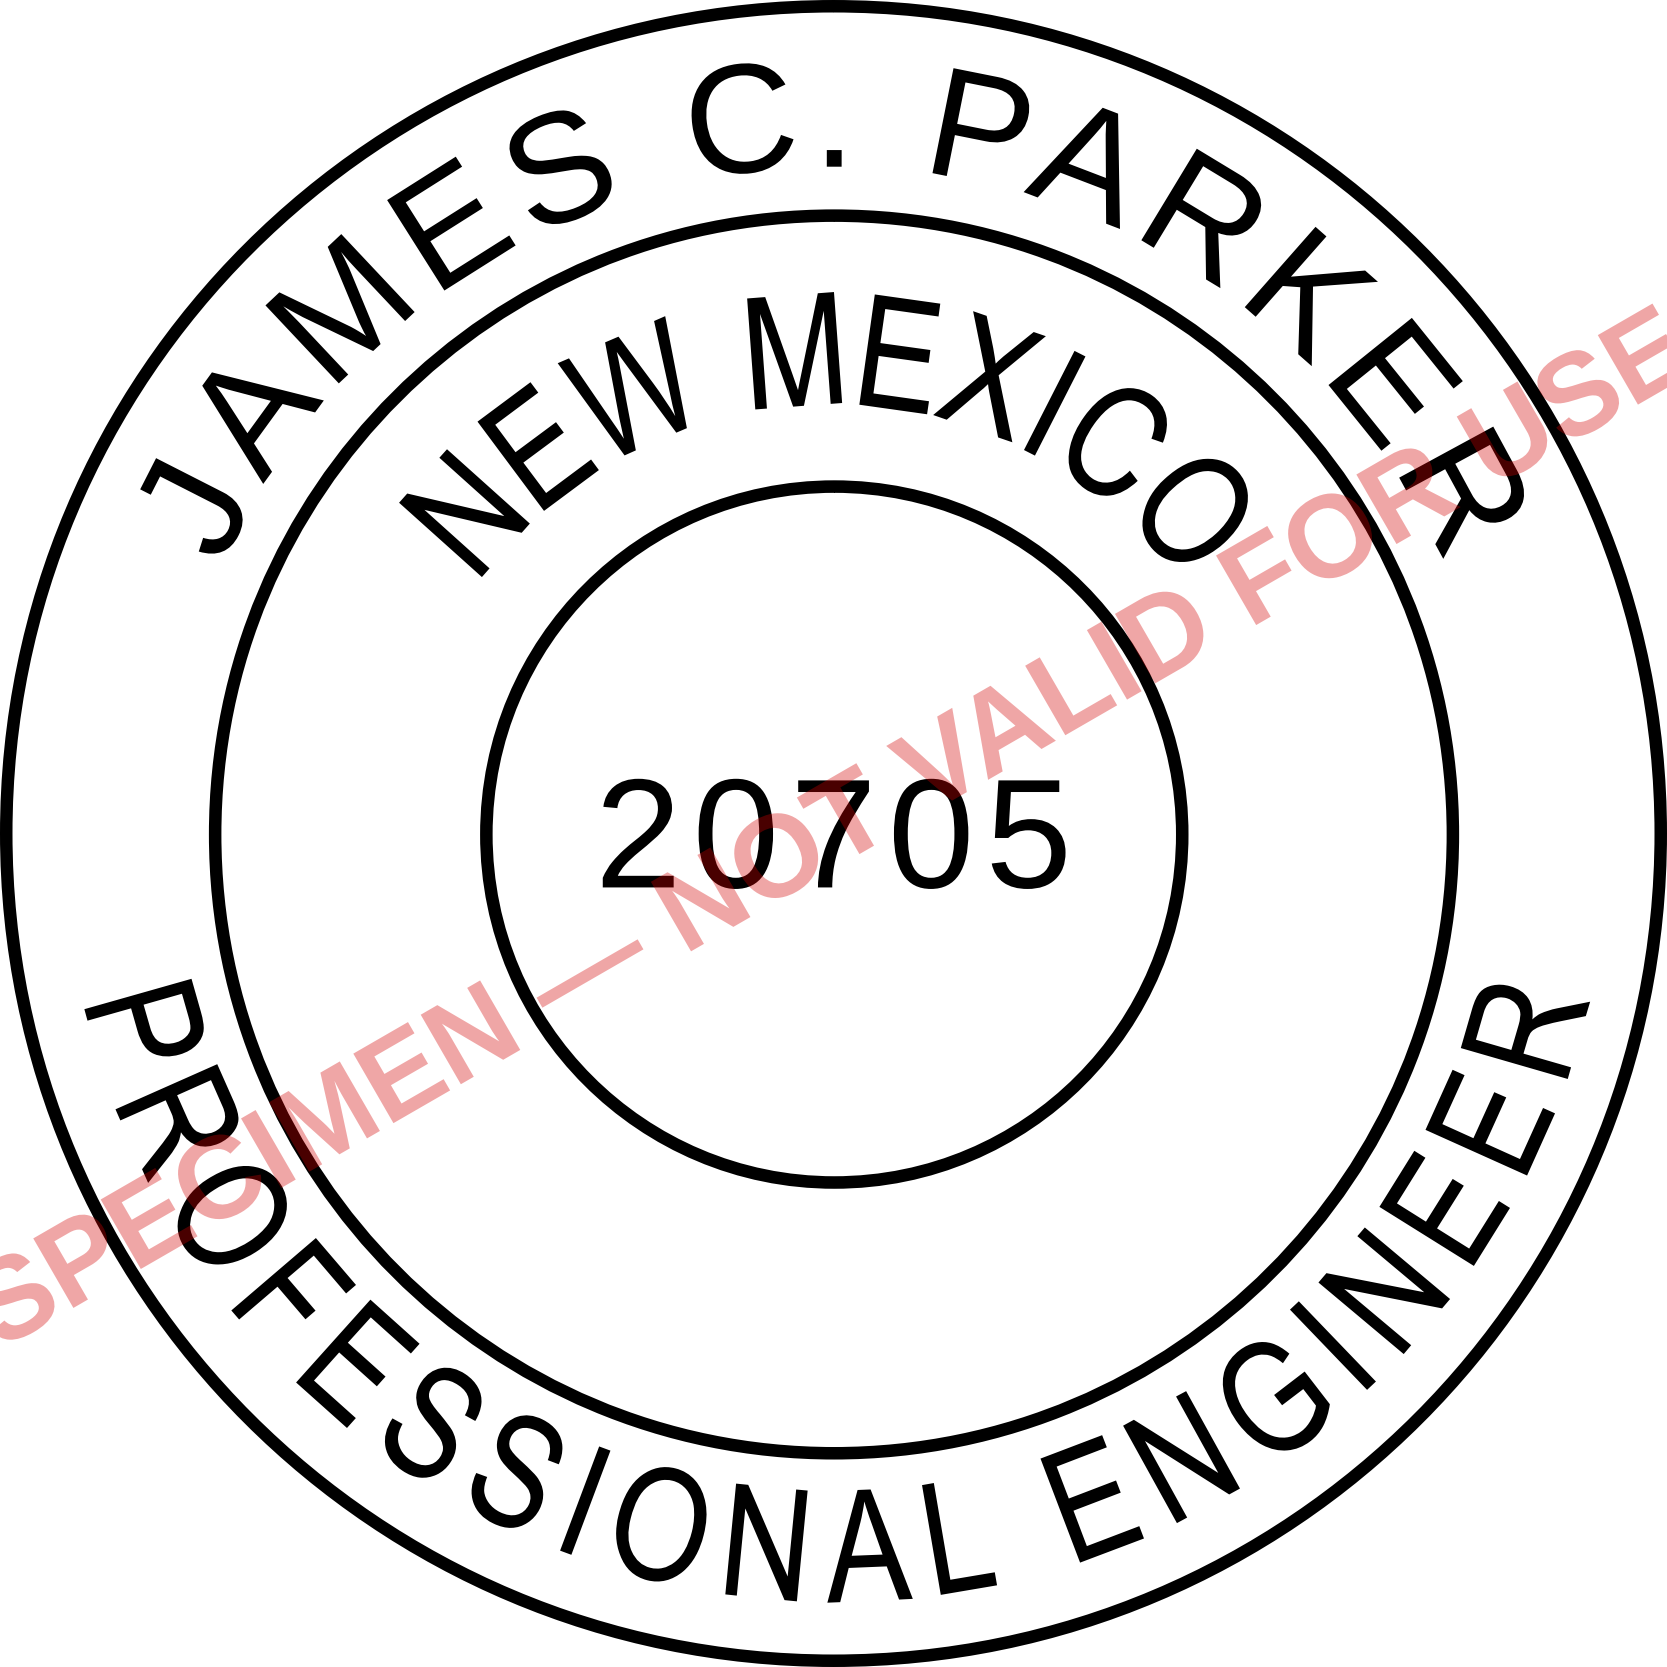

JAMES C. PARKER
NEW MEXICO
20705
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE