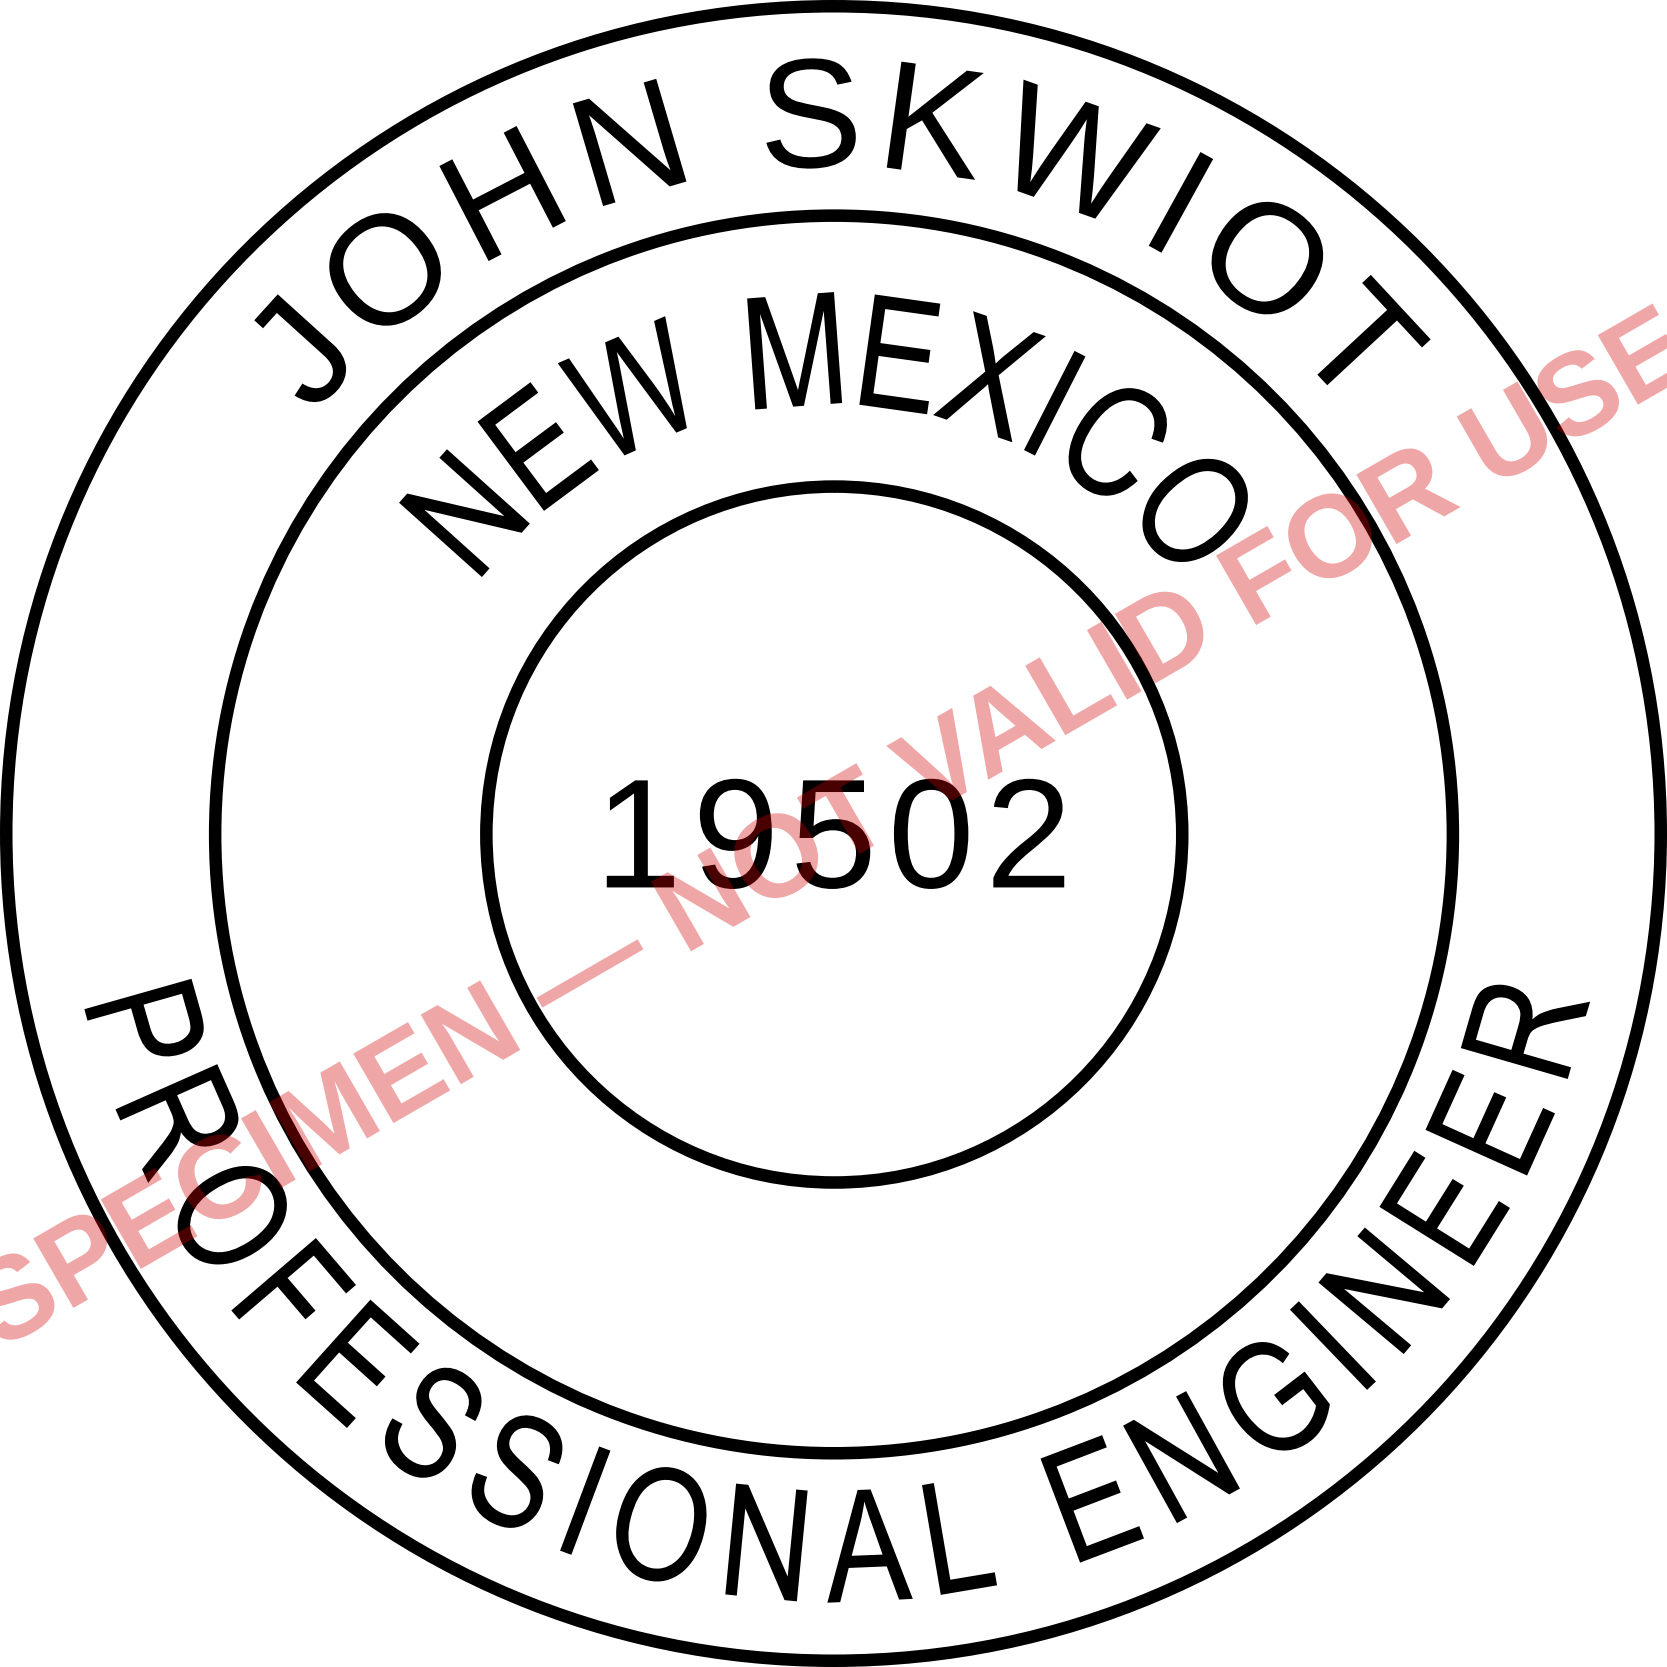

JOHN SKWIOT
NEW MEXICO
19502
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE