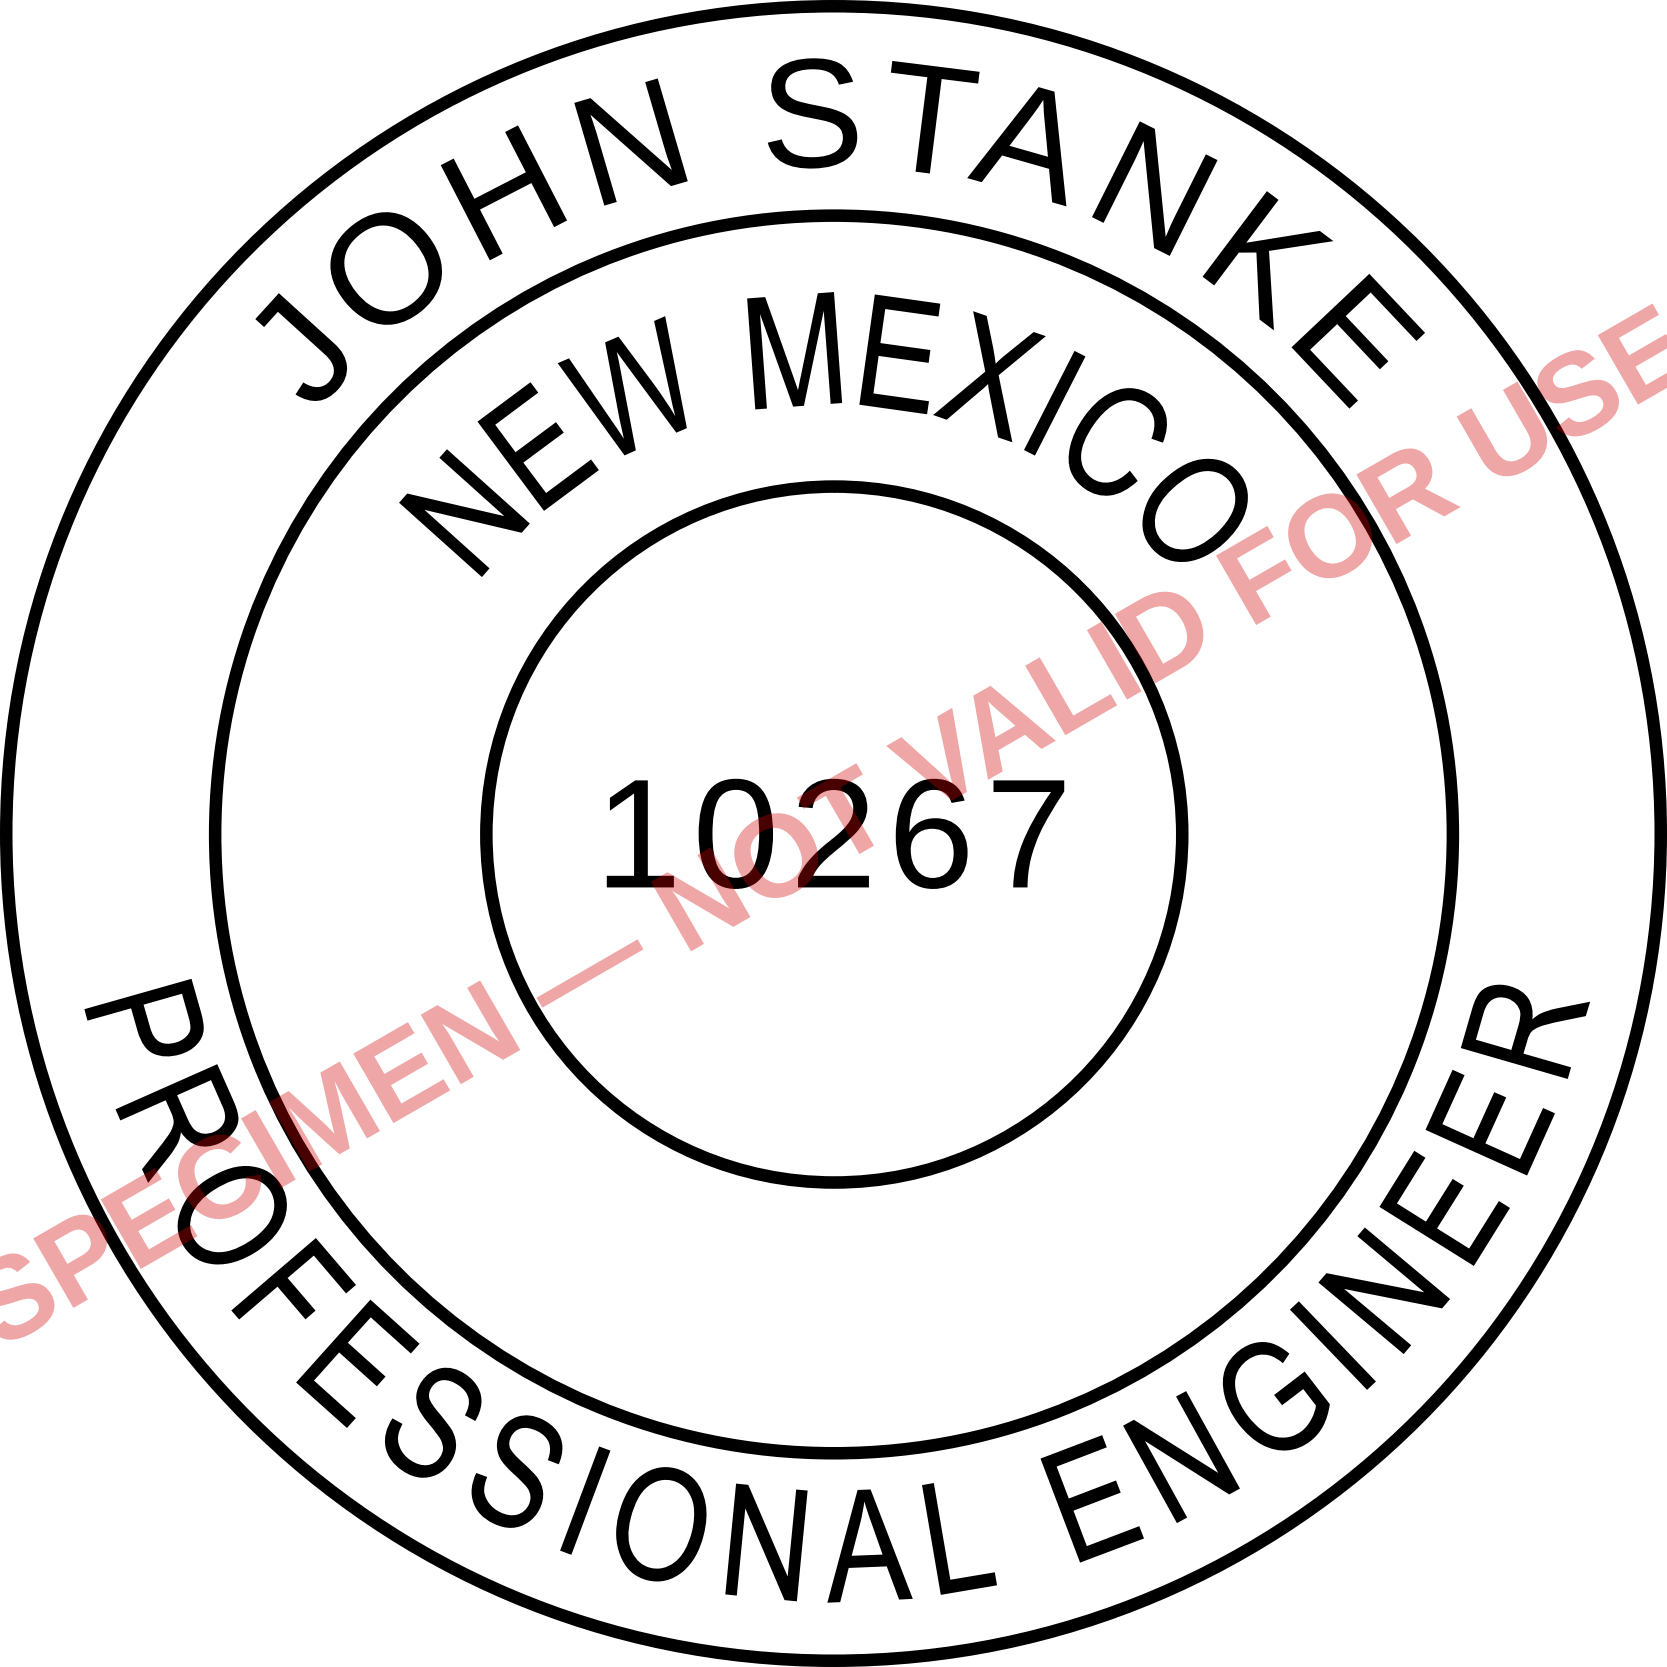

JOHN STANKE
NEW MEXICO
10267
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE