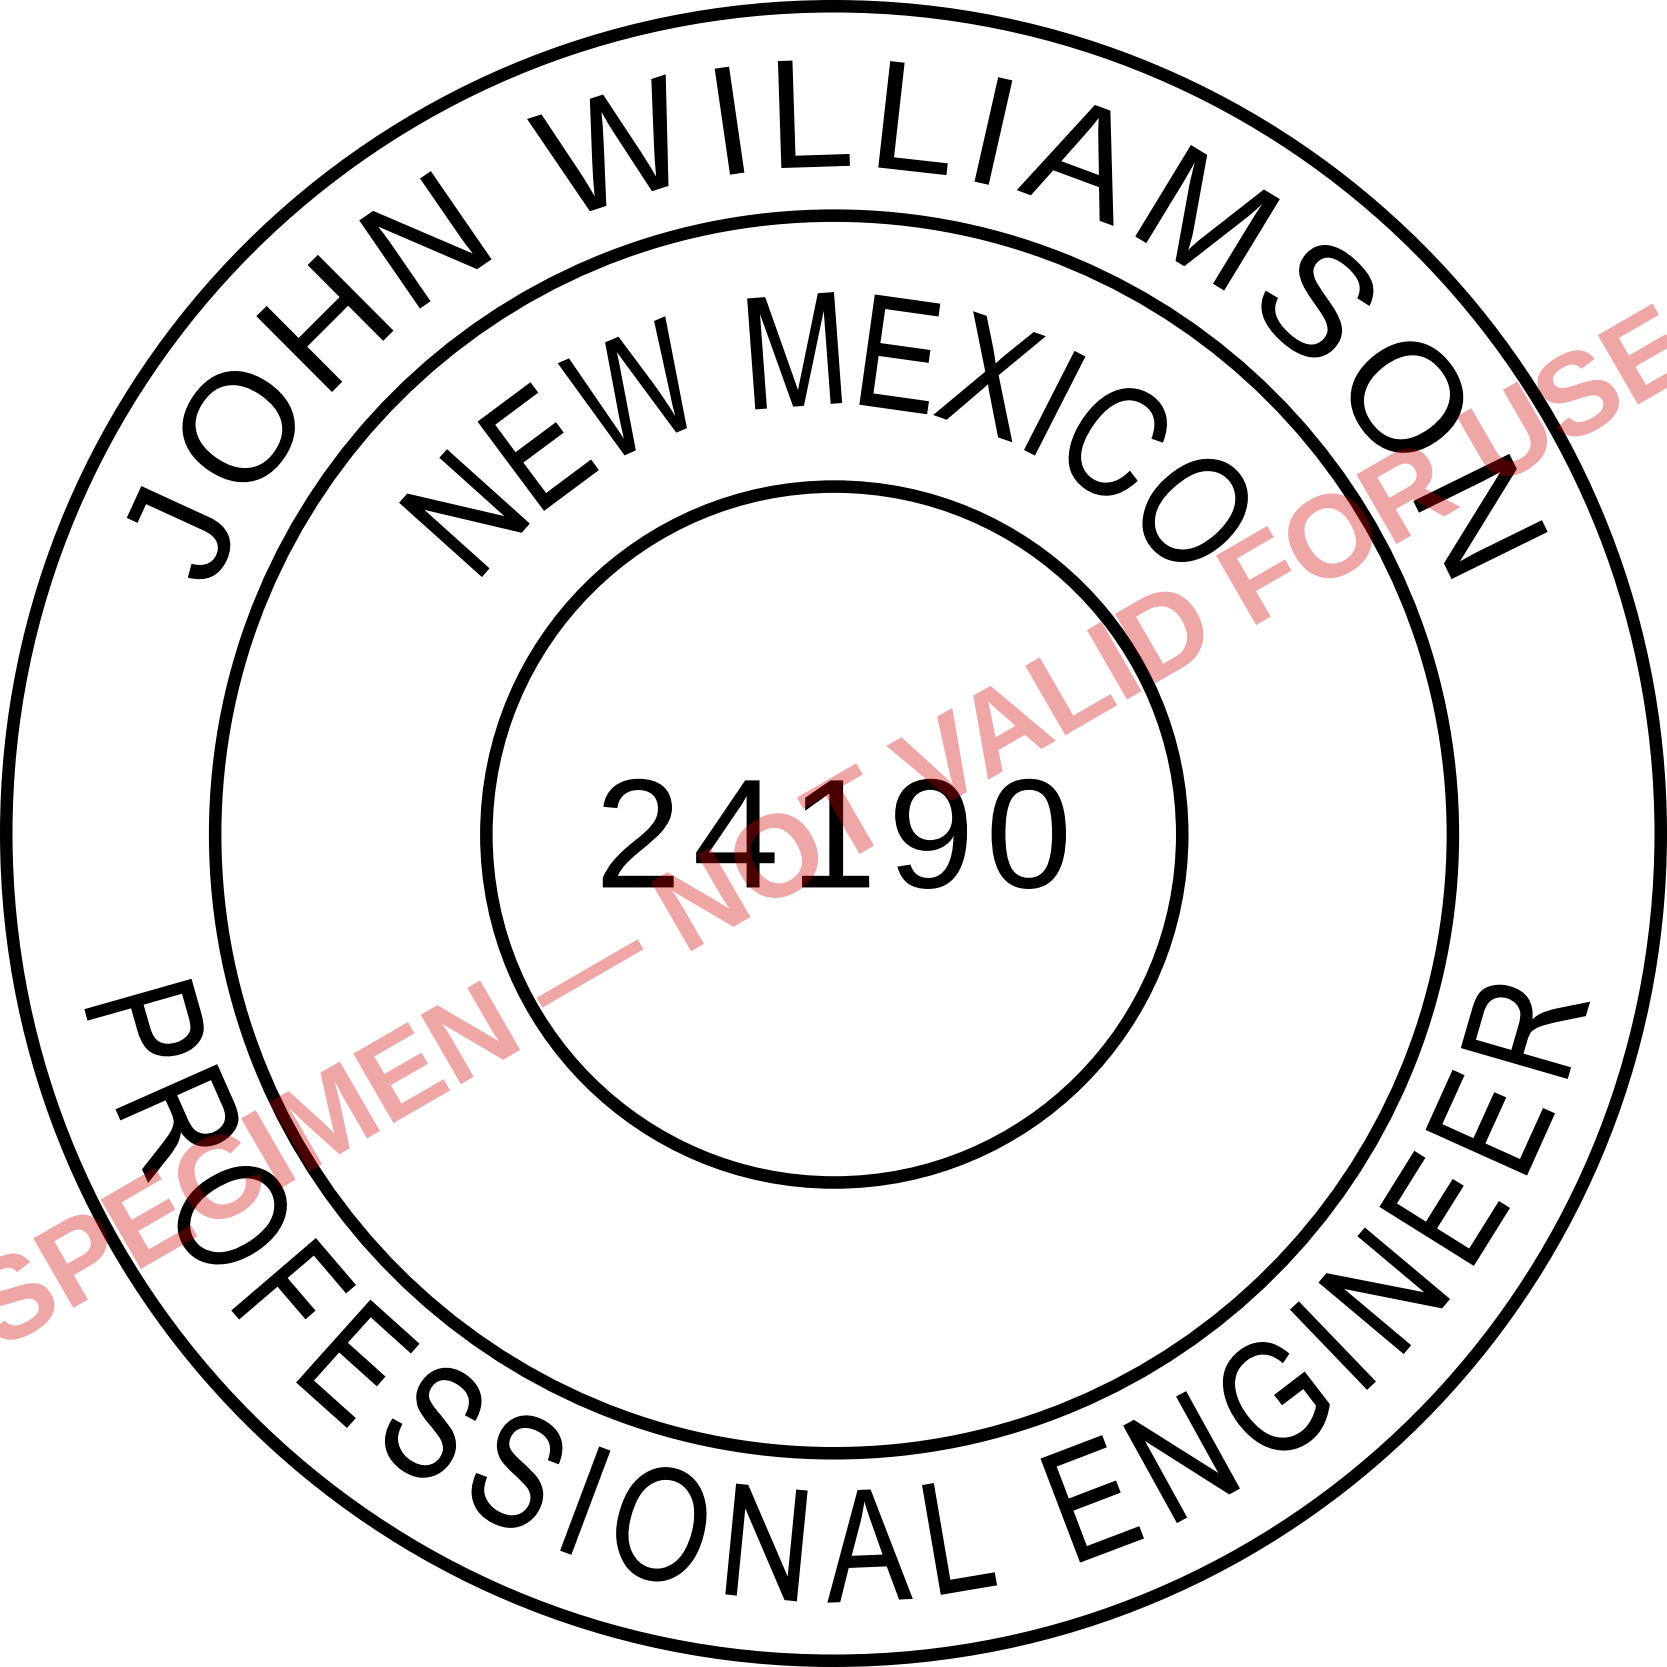

JOHN WILLIAMSON
NEW MEXICO
24190
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE