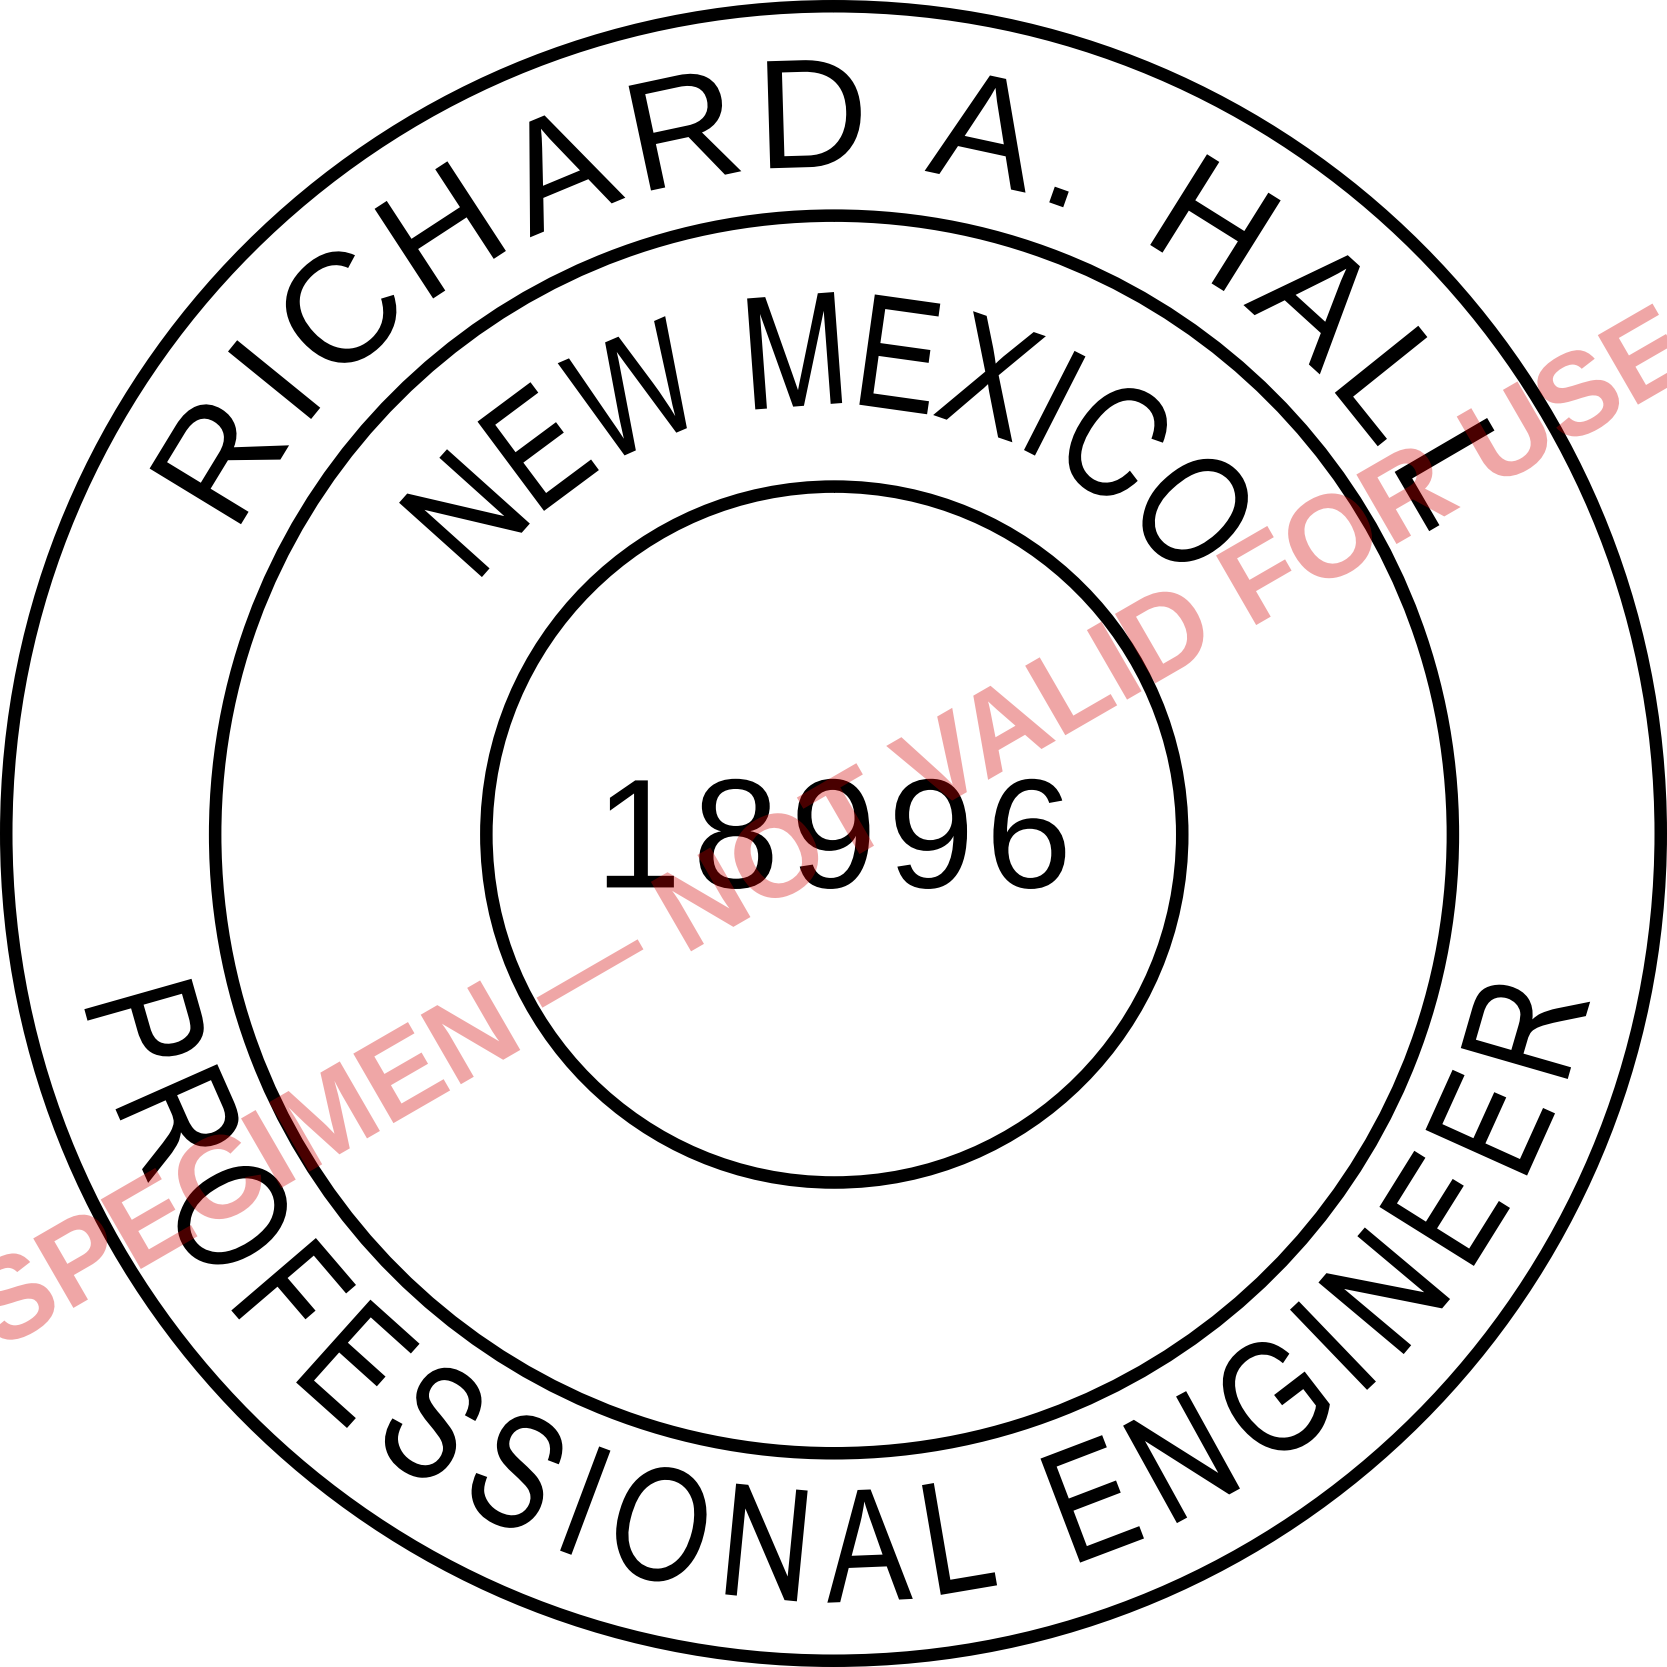
RICHARD A. HALL
NEW MEXICO
18996
PROFESSIONAL ENGINEER
SPECIMEN — NOT VALID FOR USE