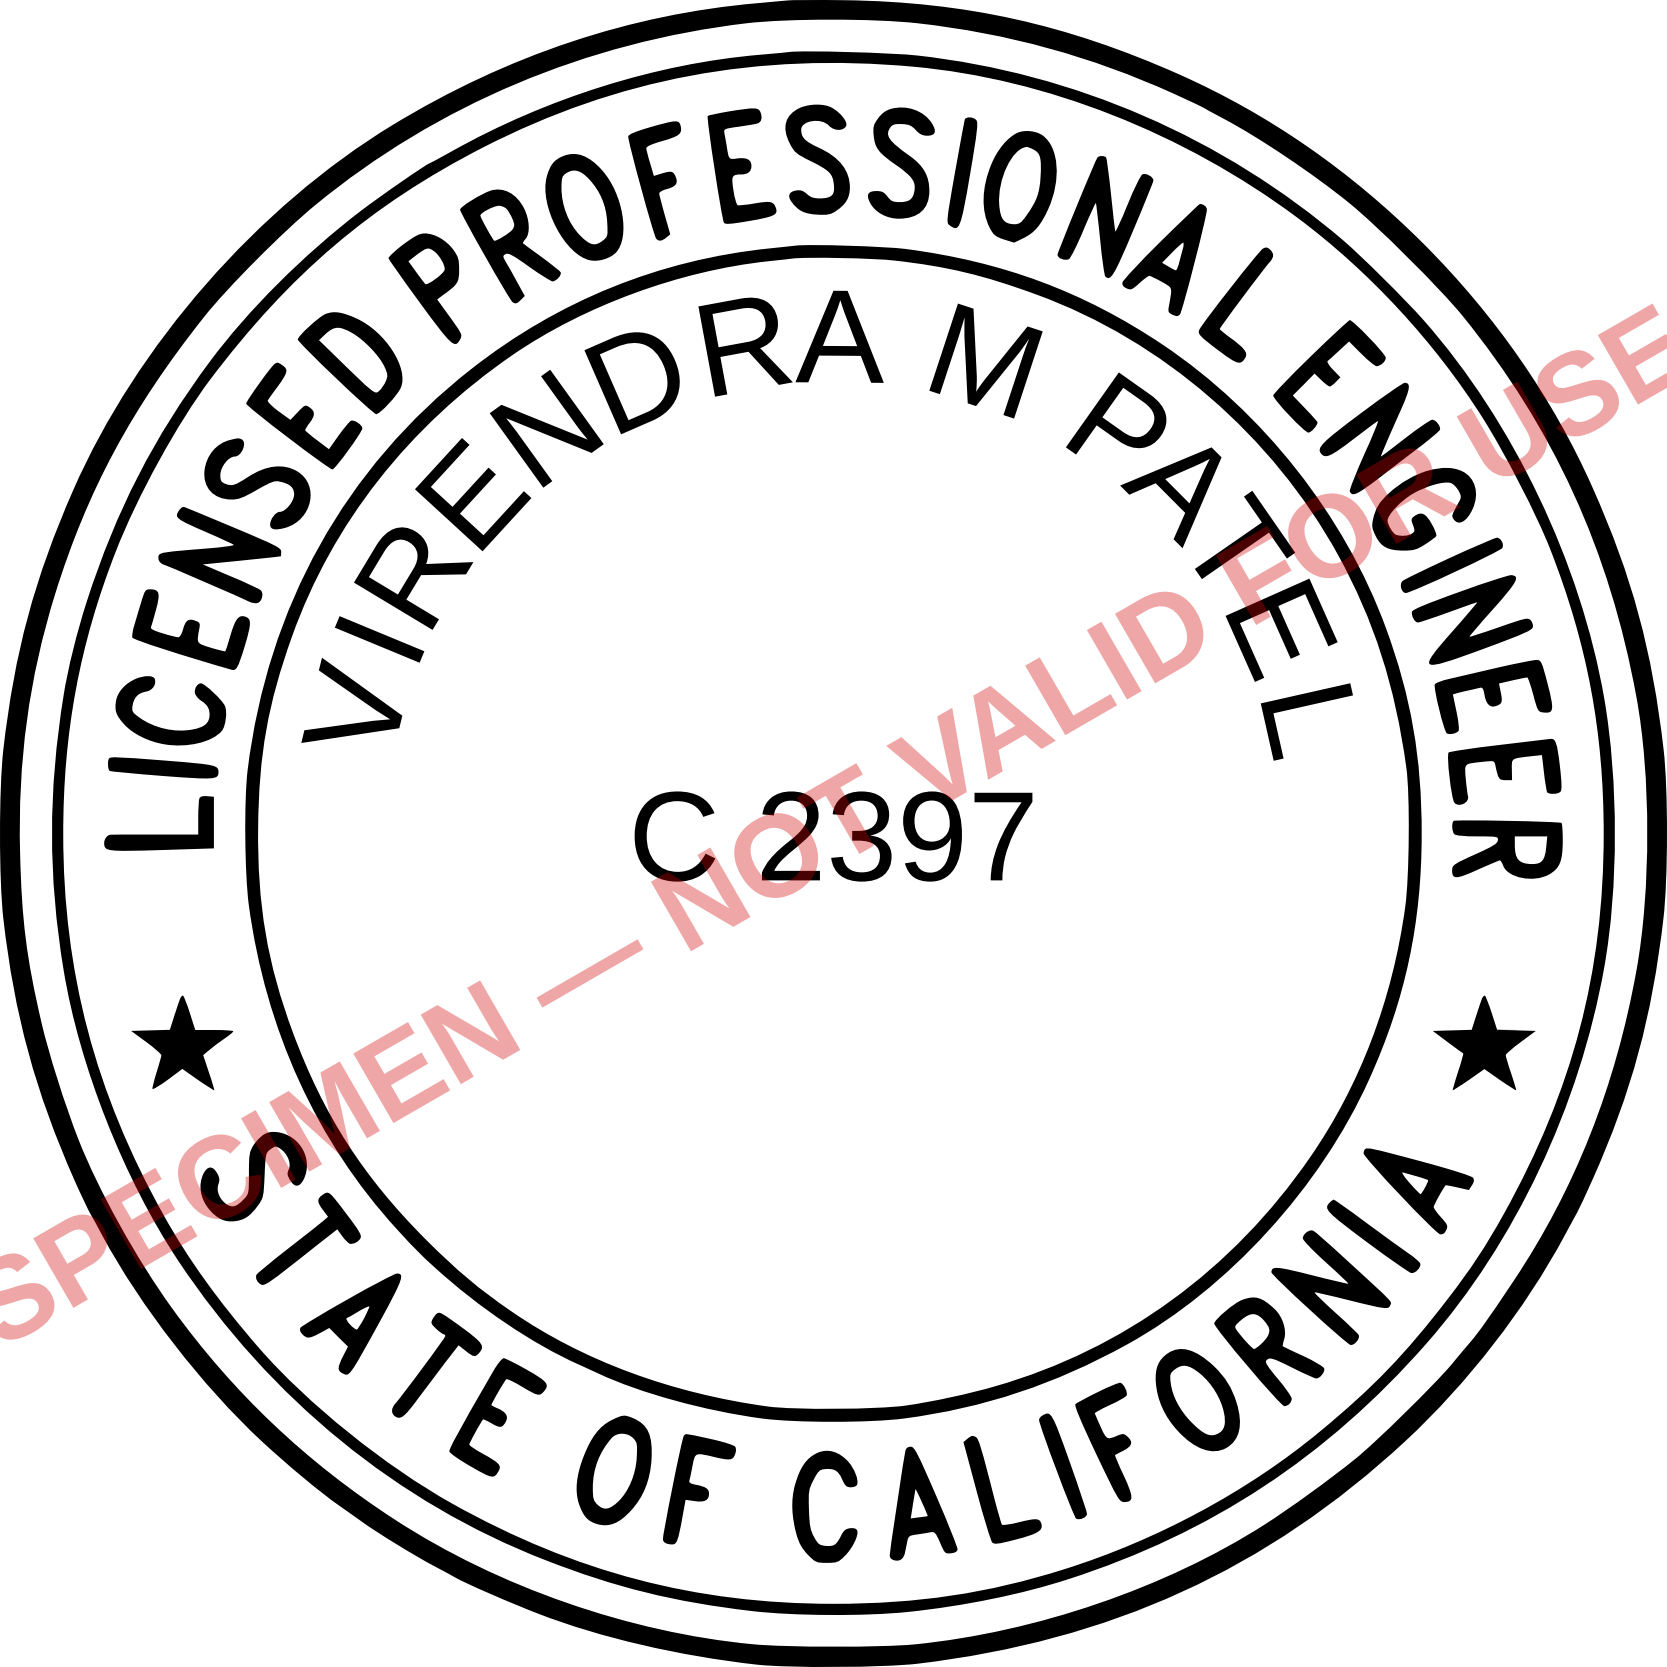

LICENSED PROFESSIONAL ENGINEER
VIRENDRA M PATEL
C 2397
STATE OF CALIFORNIA
SPECIMEN — NOT VALID FOR USE